GE 10 LSX

1 0 1 2

340109003 - GB

USE AND MAINTENANCE MANUAL
SPARE PARTS CATALOG

© MOSA 12/10/10 34010M00
preparato da UPT
approvato da DITE

The generating set is a unit which transforms the mechanical energy, generated by endothermic engine, into electric energy, through an alternator.
The gen-set is composed of a base structured to contain the fuel tank, a engine-alternator assembly fixed by means of elastic supports, a canopy hinged to the base in a way to grant quick access to the engine chamber, to the air filter and to the battery.
The gen-set is made complete by a protected frontal panel where sockets, protections and reading instruments are inserted.

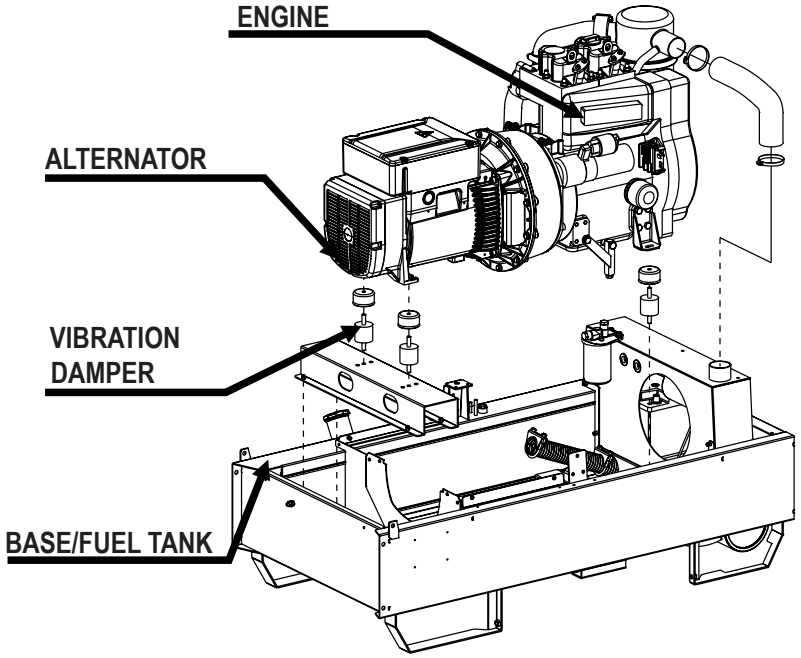

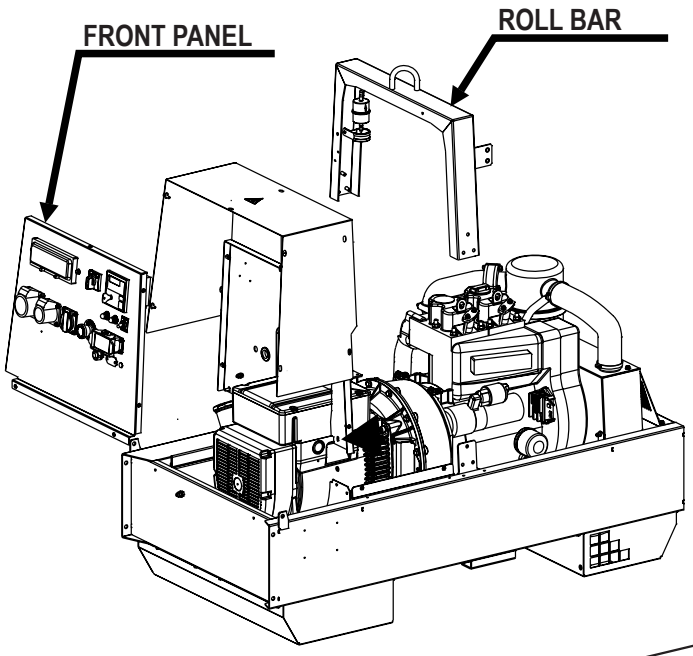

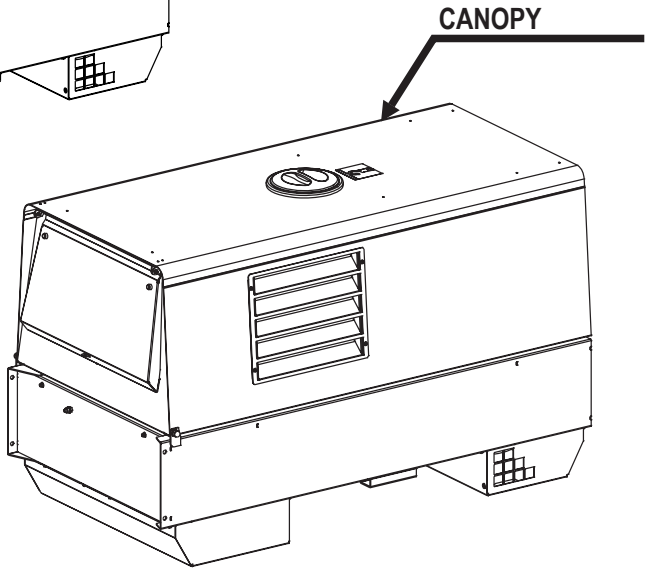

IQNet
THE INTERNATIONAL CERTIFICATION NETWORK

CERTIFICATE

CISQ/ICIM

hereby certify that the organization

BCS S.p.A.

Head Office and Operative Unit: Viale Mazzini, 161 - I-20081 Abbiategrasso (MI)
Operative Units:Via Valbrina, 17/19 - I-42045 Luzzara (RE)
Viale Europa, 59 - I-20090 Cusago (MI)

for the following field of activities

Design, production and servicing of tractors, agricultural and green maintenance machines, engine driven welders and generating sets.

has implemented and maintains a

Quality Management System

which fulfills the requirements of the following standard

ISO 9001:2008

Issued on: **2012-03-06**
Validity date: **2015-03-05**

Registration Number: IT-3722

Michael Drechsel
President of IQNET

Gianrenzo Prati
President of CISQ

IQNet Partners*:
AENOR *Spain* AFNOR Certification *France* AIB-Vincotte International *Belgium* ANCE *Mexico* APCER *Portugal* CCC *Cyprus* CISQ *Italy* CQC *China* CQM *China* CQS *Czech Republic* Cro Cert *Croatia* DQS Holding GmbH *Germany* DS *Denmark* ELOT *Greece* FCAV *Brazil* FONDONORMA *Venezuela* ICONTEC *Colombia* IMNC *Mexico* INNORPI *Tunisia* Inspecta Certification *Finland* IRAM *Argentina* JQA *Japan* KFQ *Korea* MSZT *Hungary* Nemko AS *Norway* NSAI *Ireland* PCBC *Poland* Quality Austria *Austria* RR *Russia* SII *Israel* SIQ *Slovenia* SIRIM QAS International *Malaysia* SQS *Switzerland* SRAC *Romania* TEST St Petersburg *Russia* TSE *Turkey* YUQS *Serbia*
IQNet is represented in the USA by: AFNOR Certification, CISQ, DQS Holding GmbH and NSAI Inc.
* The list of IQNet partners is valid at the time of issue of this certificate. Updated information is available under www.iqnet-certification.com

CISQ is a member of IQNet
www.iqnet-certification.com

IQNet, the association of the world's first class certification bodies, is the largest provider of management System Certification in the world. IQNet is composed of more than 30 bodies and counts over 150 subsidiaries all over the globe.

ICIM
www.icim.it

CERTIFICATO n. 0192/6
CERTIFICATE No.

SI CERTIFICA CHE IL SISTEMA DI GESTIONE PER LA QUALITA' DI
WE HEREBY CERTIFY THAT THE QUALITY MANAGEMENT SYSTEM OPERATED BY

BCS S.p.A.
UNITA' OPERATIVE
OPERATIVE UNITS

Sede e Unità Operativa
Viale Mazzini, 161 - 20081 Abbiategrasso (MI)
Unità Operative
Via Valbrina, 17/19 - 42045 Luzzara (RE)
Viale Europa, 59 - 20090 Cusago (MI)
Italia

E' CONFORME ALLA NORMA
IS IN COMPLIANCE WITH THE STANDARD

UNI EN ISO 9001:2008

PER LE SEGUENTI ATTIVITA'
FOR THE FOLLOWING ACTIVITIES

EA: 18

Progettazione, produzione ed assistenza di trattori, macchine per agricoltura e manutenzione del verde, motosaldatrici e gruppi elettrogeni.

Design, production and servicing of tractors, agricultural and green maintenance machines, engine driven welders and generating sets.

Riferirsi al Manuale della Qualità per l'applicabilità dei requisiti della norma di riferimento.
Refer to Quality Manual for details of application to reference standard requirements.
Il presente certificato è soggetto al rispetto del regolamento per la certificazione dei sistemi di gestione per la qualità delle aziende.
The use and the validity of this certificate shall satisfy the requirements of the rules for the certification of company quality management systems.

Data emissione *First issue*	Emissione corrente *Current issue*	Data di scadenza *Expiring date*
30/05/1994	06/03/2012	05/03/2015

ICIM S.p.A.
Piazza Don Enrico Mapelli, 75 – 20099 Sesto San Giovanni (MI)

ACCREDIA
ENTE ITALIANO DI ACCREDITAMENTO
SGQ N° 004A SSI N° 008Q
SGA N° 005D PRD N° 004B
SCR N° 006F ISP N° 046E
Membro degli Accordi di Mutuo Riconoscimento EA, IAF e ILAC
Signatory of EA, IAF and ILAC Mutual Recognition Agreements

CISQ è la Federazione Italiana di Organismi di Certificazione dei sistemi di gestione aziendale.
CISQ is the Italian Federation of management system Certification Bodies.

FEDERAZIONE CISQ
www.cisq.com

ICIM CISQ IQNet
ISO 9001:2008 - Cert. 0192

UNI EN ISO 9001 : 2008

MOSA has certified its quality system according to UNI EN ISO 9001:2008 to ensure a constant, highquality of its products. This certification covers thedesign, production and servicing of engine drivenwelders and generating sets.

The certifying institute, ICIM, which is a member ofthe International Certification Network IQNet, awarded the official approval to MOSA after an examination of its operations at the head office andplant in Cusago (MI), Italy.

This certification is not a point of arrival but a pledgeon the part of the entire company to maintain a levelof quality of both its products and services whichwill continue to satisfy the needs of its clients, aswell as to improve the transparency and thecommunications regarding all the company's activesin accordance with the official procedures and inharmony with the MOSA Manual of Quality.

The advantages for MOSA clients are:

·Constant quality of products and services at thehigh level which the client expects;

· Continuous efforts to improve the products andtheir performance at competitive conditions;

· Competent support in the solution of problems;

· Information and training in the correct applicationand use of the products to assure the security ofthe operator and protect the environment;

· Regular inspections by ICIM to confirm that therequirements of the company's quality systemand ISO 9001 are being respected.

All these advantages are guaranteed by the CERTIFICATE OF QUALITY SYSTEM No.0192 issued by ICIM S.p.A. - Milano (Italy) - www.icim.it

M 0 DESCRIPTION OF THE MACHINE
M 01 QUALITY SYSTEM
M 1.01 COPYRIGHT
M 1.1 NOTES
M 1.4 CE MARK
M 1.4.1 DECLARATION OF CONFORMITY
M 1.5 TECHNICAL DATA
M 2 - 2.1 SYMBOLS AND SAFETY PRECAUTIONS
M 2.5 -…. INSTALLATION AND ADVICE BEFORE USE
M 2.6 INSTALLATION AND ADVICE
M 2.7... INSTALLATION AND DIMENSIONS
M 3 UNPACKING
M 4 TRANSPORT OF GENSETS W/CANOPY
M 6.2 ASSEMBLY: CTL 400
M 20 SET-UP FOR OPERATION (Diesel/ Air)
M 21 STARTING AND STOPPING (EP6)
M 31 COMMANDS
M 32 COMPONENTS OF FRONTAL PANEL
M 37 -….. USE AS A GENERATOR
M 38.6 REMOTE CONTROL CTM35
M 39.12 ENGINE PROTECTION EP6
M 40.2 TROUBLE SHOOTING (Diesel engine)
M 43 -….. MAINTENANCE
M 45 STORAGE
M 46 CUST OFF
M 60 ELECTRICAL SYSTEM LEGEND
M 61-….. ELECTRICAL SYSTEM

R1 SPARE PARTS TABLES
HK ... SPARE PARTS
K... ACCESSORIES

ATTENTION

This use and maintenance manual is an important part of the machines in question.
The assistance and maintenance personel must keep said manual at disposal, as well as that for the engine and alternator (if the machine is synchronous) and all other documentation about the machine.

We advise you to pay attention to the pages concerning the security (see page M1.1).

© All rights are reserved to said Company.

It is a property logo of MOSA division of B.C.S. S.p.A. All other possible logos contained in the documentation are registered by the respective owners.

☞ The reproduction and total or partial use, in any form and/or with any means, of the documentation is allowed to nobody without a written permission by MOSA division of B.C.S. S.p.A.

To this aim is reminded the protection of the author's right and the rights connected to the creation and design for communication, as provided by the laws in force in the matter.

In no case MOSA division of B.C.S. S.p.A. will be held responsible for any damaga, direct or indirect, in relation with the use of the given information.

MOSA division of B.C.S. S.p.A. does not take any responsibility about the shown information on firms or individuals, but keeps the right to refuse services or information publication which it judges discutible, unright or illegal.

INFORMATION

Dear Customer,
We wish to thank you for having bought a high quality set.

Our sections for Technical Service and Spare Parts will work at best to help you if it were necessary.

To this purpose we advise you, for all control and overhaul operations, to turn to the nearest authorized Service Centre, where you will obtain a prompt and specialized intervention.

☞ In case you do not profit on these Services and some arts are replaced, please ask and be sure that are used exclusively original parts; this to guarantee that the performances and the initial safety prescribed by the norms in force are re-established.

☞ *The use of* ***non original spare parts will cancel immediately*** *any guarantee and Technical Service obligation.*

NOTES ABOUT THE MANUAL

Before actioning the machine please read this manual attentively. Follow the instructions contained in it, in this way you will avoid inconveniences due to negligence, mistakes or incorrect maintenance. The manual is for qualified personnel, who knows the rules: about safety and health, installation and use of sets movable as well as fixed.

You must remember that, in case you have difficulties for use or installation or others, our Technical Service is always at your disposal for explanations or interventions.

The manual for Use Maintenance and Spare Parts is an integrant part of the product. It must be kept with care during all the life of the product.
In case the machine and/or the set should be yielded to another user, this manual must also given to him.
Do not damage it, do not take parts away, do not tear pages and keep it in places protected from dampness and heat.

You must take into account that some figures contained in it want only to identify the described parts and therefore might not correspond to the machine in your possession.

INFORMATION OF GENERAL TYPE

In the envelope given together with the machine and/or set you will find: the manual for Use Maintenance and Spare Parts, the manual for use of the engine and the tools (if included in the equipment), the guarantee (in the countries where it is prescribed by law).

Our products have been designed for the use of generation for welding, electric and hydraulic system; ANY OTHER DIFFERENT USE NOT INCLUDED IN THE ONE INDICATED, relieves the manufacturer from the risks which could happen or, anyway, from that which was agreed when selling the machine. The manufacturer excludes any responsibility for damages to the machine, to the things or to persons in this case.

Our products are made in conformity with the safety norms in force, for which it is advisable to use all these devices or information so that the use does not bring damage to persons or things.

While working it is advisable to keep to the personal safety norms in force in the countries to which the product is destined (clothing, work tools, etc.).

Do not modify for any motive parts of the machine (fastenings, holes, electric or mechanical devices, others..) if not duly authorized in writing: the responsibility coming from any potential intervention will fall on the executioner as in fact he becomes maker of the machine.

☞ ***Notice:*** *this manual does not engage the manufacturer, who keeps the faculty, apart the essential characteristics of the model here described and illustrated, to bring betterments and modifications to parts and accessories, without putting this manual uptodate immediately.*

Any of our product is labelled with CE marking attesting its conformity to appliable directives and also the fulfillment of safety requirements of the product itself; the list of these directives is part of the declaration of conformity included in any machine standard equipment.
Here below the adopted symbol:

CE marking is clearly readable and unerasable and it can be either part of the data-plate.

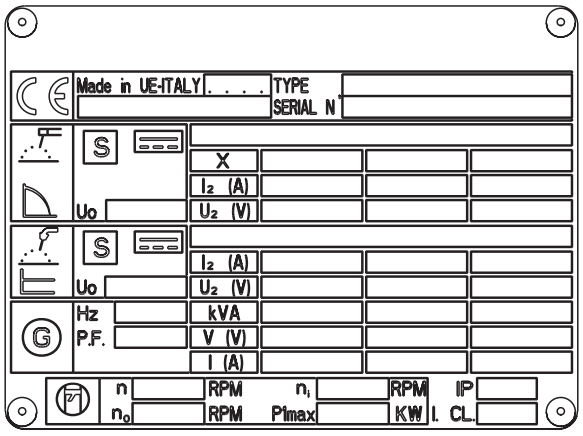

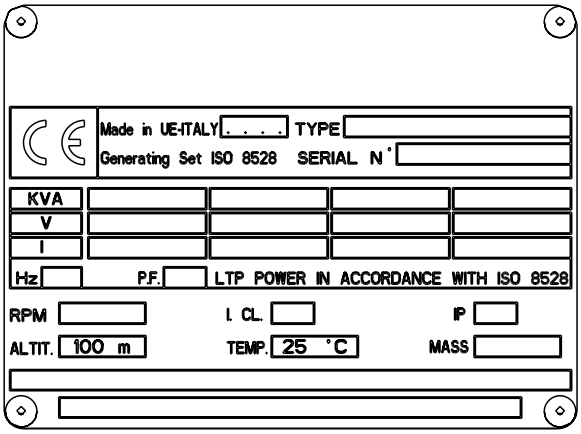

Furthermore, on each model it is shown the noise level value; the symbol used is the following:

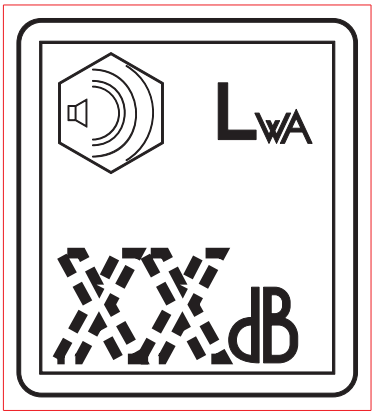

The indication is shown in a clear, readable and indeleble way on a sticker.

BCS S.p.A.
Sede legale:
Via Marradi 1
20123 Milano - Italia

Stabilimento di Cusago, 20090 (MI) - Italia
V.le Europa 59
Tel.: +39 02 903521
Fax: +39 02 90390466

ISO 9001:2000 - Cert. 0192

DICHIARAZIONE DI CONFORMITA'

Déclaration de Conformité – Declaration of Conformity – Konformitätserklärung
Conformiteitsverklaring – Declaración de Conformidad

BCS S.p.A. dichiara sotto la propria responsabilità che la macchina:
BCS S.p.A. déclare, sous sa propre responsabilité, que la machine:
BCS S.p.A. declares, under its own responsibility, that the machine:
BCS S.p.A. erklärt, daß die Aggregate:
BCS S.p.A. verklaard, onder haar eigen verantwoordelijkheid, dat de machine:
BCS S.p.A. declara bajo su responsabilidad que la máquina:

GRUPPO ELETTROGENO DI SALDATURA / WELDING GENERATOR ☐

GRUPPO ELETTROGENO / POWER GENERATOR ☐

Marchio / Brand : _MOSA_____

Modello / Model : _____

Matricola / Serial number : _____

FAC SIMILE

è conforme con quanto previsto dalle Direttive Comunitarie e relative modifiche:
est en conformité avec ce qui est prévu par les Directives Communautaires et relatives modifications:
conforms with the Community Directives and related modifications:
mit den Vorschriften der Gemeinschaft und deren Ergänzungen übereinstimmt:
in overeenkomst is met de inhoud van gemeenschapsrichtlijnemen gerelateerde modificaties:
comple con los requisítos de la Directiva Comunitaria y sus anexos:

2006/42/CE - 2006/95/CE - 2004/108/CE

Nome e indirizzo della persona autorizzata a costituire il fascicolo tecnico :
Nom et adresse de la personne autorisée à composer le Dossier Technique :
Person authorized to compile the technical file and address :
Name und Adresse der zur Ausfüllung der technischen Akten ermächtigten Person :
Persoon bevoegd om het technische document , en bedrijf gegevens in te vullen
Nombre y dirección de la persona autorizada a componer el expediente técnico :

ing. Benso Marelli - Amministratore Delegato / CEO; V.le Europa 59, 20090 Cusago (MI) - Italy

Cusago,

Ing. Benso Marelli
Amministratore Delegato
CEO

Technical data	GE 10 LSX
GENERATOR	
*Stand-by three-phase power	11 kVA (8.8kW) / 400 V / 15.9 A
*PRP three-phase power	10 kVA (8 kW) / 400 V / 14.4 A
*PRP single-phase power	4.5 kVA (9 kW) / 230 V / 19.5 A
Frequecy	50 Hz
Cos φ	0.8
* Output powers according to ISO 8528-1	
ALTERNATOR	Self-excited, self-regulated, brushless
Type	Three-phase, synchronous
Insulation class	H
ENGINE	
Make / Model	LOMBARDINI 9LD 625/2
Type / Cooling system	Diesel 4-Stroke / air
Cylinder / Displacement	2 / 1248 cm^3
*Stand by net power	10.7 kW (14.5 HP)
**PRP net power	9.7 kW (13.1 HP)
Speed	1500 rpm
Fuel consumption (75% of PRP)	2 l/h
Engine oil capacity	2.8 l
Starter	Electric
* Output powers according to ISO 3046-1	
GENERAL SPECIFICATIONS	
Tank capacity	26 l
Running time (75% of PRP)	13 h
Protection	IP 23
*Dimensions / max. on base Lxwxh	1455x870x880
*Weight on base	440 Kg
Measured acoustic power Lwa (pression LpA)	94 dB(A) (69 dB(A) @ 7 m)
Garanteed acoustic power Lwa (pression LpA	95 dB(A) (70 dB(A) @ 7 m) LWA 2000 / 14 / CE
* Dimensions and weight are inclusive of all parts.	

OUTPUT

Declared power according to ISO 8528-1 (temperature 25°C, 30% relative humidity, altitude 100 m above sea level).
(*Stand-by) = maximum available power for use at variable loads for a yearly number of hours limited at 500 h. No overload is admitted.
(**Prime power PRP) = maximum available power for use at variable loads for a yearly illimited number of hours. The average power to be taken during a period of 24 h must not be over 80% of the PRP.
It's admitted overload of 10% each hour every 12 h.
In an **approximative** way one reduces: of 1% every 100 m altitude and of 2.5% for every 5°C above 25°C.

ACOUSTIC POWER LEVEL

ATTENTION: The concrete risk due to the machine depends on the conditions in which it is used. Therefore, it is up to the end-user and under his direct responsibility to make a correct evaluation of the same risk and to adopt specific precautions (for instance, adopting a I.P.D. -Individual Protection Device)

Acoustic Noise Level (L_{WA}) - Measure Unit dB(A): it stands for acoustic noise released in a certain delay of time. This is not submitted to the distance of measurement.

Acoustic Pressure (Lp) - Measure Unit dB(A): it measures the pressure originated by sound waves emission. Its value changes in proportion to the distance of measurement.

The here below table shows examples of acoustic pressure (Lp) at different distances from a machine with Acoustic Noise Level (L_{WA}) of 95 dB(A)

Lp a 1 meter = 95 dB(A) - 8 dB(A) = 87 dB(A)
Lp a 4 meters = 95 dB(A) - 20 dB(A) = 75 dB(A)
Lp a 7 meters = 95 dB(A) - 25 dB(A) = 70 dB(A)
Lp a 10 meters = 95 dB(A) - 28 dB(A) = 67 dB(A)

PLEASE NOTE: the symbol LWA when with acoustic noise values, indicates that the device respects noise emission limits according to 2000/14/CE directive.

SYMBOLS IN THIS MANUAL

- The symbols used in this manual are designed to call your attention to important aspects of the operation of the machine as well as potential hazards and dangers for persons and things.

IMPORTANT ADVICE

- Advice to the User about the safety:

☞ N.B.: The information contained in the manual can be changed without notice. Potential damages caused in relation to the use of these instructions will not be considered because these are only indicative. Remember that the non observance of the indications reported by us might cause damage to persons or things. It is understood, that local dispositions and/or laws must be respected.

WARNING

Situations of danger - no harm to persons or things

Do not use without protective devices provided
Removing or disabling protective devices on the machine is prohibited.

Do not use the machine if it is not in good technical condition
The machine must be in good working order before being used. Defects, especially those which regard the safety of the machine, must be repaired before using the machine.

SAFETY PRECAUTIONS

DANGEROUS

This heading warns of an immediate danger for persons as well for things. Not following the advice can result in serious injury or death.

WARNING

This heading warns of situations which could result in injury for persons or damage to things.

CAUTION

To this advice can appear a danger for persons as well as for things, for which can appear situations bringing material damage to things.

IMPORTANT

NOTE

ATTENTION

These headings refer to information which will assis you in the correct use of the machine and/or accessories.

SYMBOLS

STOP **-** Read absolutely and be duly attentive

Read and pay due attention

GENERAL ADVICE **-** If the advice is not respected damage can happen to persons or things.

HIGH VOLTAGE **-** Attention High Voltage. There can be parts in voltage, dangerous to touch. The non observance of the advice implies life danger.

FIRE **-** Danger of flame or fire. If the advice is not respected fires can happen.

HEAT **-** Hot surfaces. If the advice is not respected burns or damage to things can be caused.

EXPLOSION **-** Explosive material or danger of explosion. in general. If the advice is not respected there can be explosions.

WATER **-** Danger of shortcircuit. If the advice is not respected fires or damage to persons can be caused.

SMOKING **-** The cigarette can cause fire or explosion. If the advice is not respected fires or explosions can be caused.

ACIDS **-** Danger of corrosion. If the advice is not respected the acids can cause corrosions with damage to persons or things.

WRENCH **-** Use of the tools. If the advice is not respected damage can be caused to things and even to persons.

PRESSION **-** Danger of burns caused by the expulsion of hot liquids under pressure.

ACCES FORBIDDEN *to non authorizad* peaple.

PROHIBITIONS No harm for persons

Use only with safety clothing -

It is compulsory to use the personal protection means given in equipment.

Use only with safety clothing -

It is compulsory to use the personal protection means given in equipment.

Use only with safety protections -

It is a must to use protection means suitable for the different welding works.

Use with only safety material -

It is prohibited to use water to quench fires on the electric machines.

Use only with non inserted voltage -

It is prohibited to make interventions before having disinserted the voltage.

No smoking -

It is prohibited to smoke while filling the tank with fuel.

No welding -

It is forbidden to weld in rooms containing explosive gases.

ADVICE <u>No harm for persons and things</u>

Use only with safety tools, adapted to the specific use -

It is advisable to use tools adapted to the various maintenance works.

Use only with safety protections, specifically suitable

It is advisable to use protections suitable for the different welding works.

Use only with safety protections -

It is advisable to use protections suitable for the different daily checking works.

Use only with safety protections -

It is advisable to use all protections while shifting the machine.

Use only with safety protections -

It is advisable to use protections suitable for the different daily checking works.and/or of maintenance.

The installation and the general advice concerning the operations, are finalized to the correct use of the machine, in the place where it is used as generator group and/or welder.

ENGINE	CHECKING BOARD
Stop engine when fueling	Do not touch electric devices if you are barefoot or with wet clothes.
Do not smoke, avoid flames, sparks or electric tools when fueling.	Always keep off leaning surfaces during work operations.
Unscrew the cap slowly to let out the fuel vapours.	Static electricity can demage the parts on the circuit.
Slowly unscrew the cooling liquid tap if the liquid must be topped up.	An electric shock can kill
The vapor and the heated cooling liquid under pressure can burn face, eyes, skin.	
Do not fill tank completely.	
Wipe up spilled fuel before starting engine.	
Shut off fuel of tank when moving machine (where it is assembled).	
Avoid spilling fuel on hot engine.	
Sparks may cause the explosion of battery vapours	

☞ **FIRST AID.** In case the operator shold be sprayed by accident, from corrosive liquids a/o hot toxic gas or whatever event which may cause serious injuries or death, predispose the first aid in accordance with the ruling labour accident standards or of local instructions.

Skin contact	Wash with water and soap
Eyes contact	Irrigate with plenty of water, if the irritation persists contact a specialist
Ingestion	Do not induce vomit as to avoid the intake of vomit into the lungs, send for a doctor
Suction of liquids from lungs	If you suppose that vomit has entered the lungs (as in case of spontaneous vomit) take the subject to the hospital with the utmost urgency
Inhalation	In case of exposure to high concentration of vapours take immediately to a non polluted zone the person involved

☞ **FIRE PREVENTION.** In case the working zone,for whatsoever cause goes on fire with flames liable to cause severe wounds or death, follow the first aid as described by the ruling norms or local ones.

EXTINCTION MEANS	
Appropriated	Carbonate anhydride (or carbon dioxyde) powder, foam, nebulized water
Not to be used	Avoid the use of water jets
Other indications	Cover eventual shedding not on fire with foam or sand, use water jets to cool off the surfaces close to the fire
Particular protection	Wear an autorespiratory mask when heavy smoke is present
Useful warnings	Avoid, by appropriate means to have oil sprays over metallic hot surfaces or over electric contacts (switches,plugs,etc.). In case of oil sprinkling from pressure circuits, keep in mind that the inflamability point is very low.

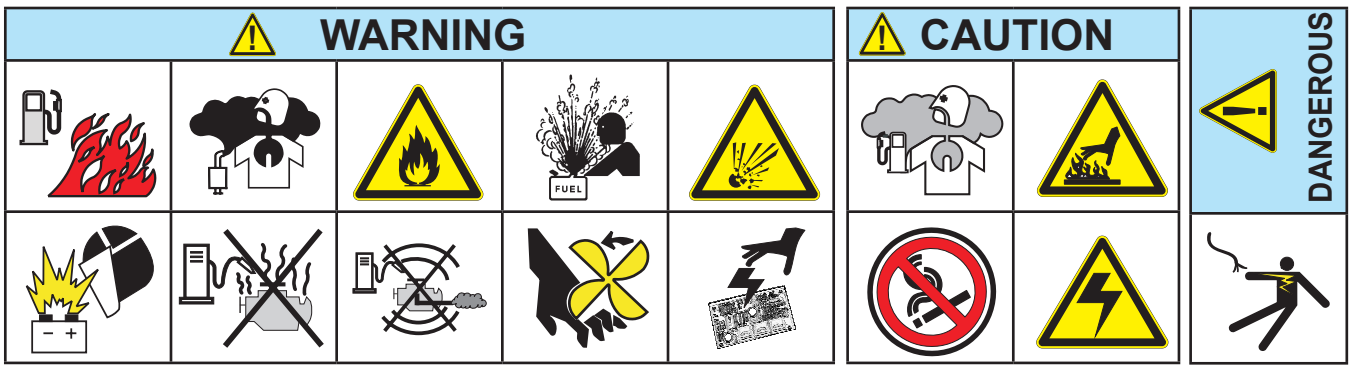

WARNING — ***THE MACHINE MUST NOT BE USED IN AREAS WITH EXPLOSIVE ATMOSPHERE***

INSTALLATION AND ADVICE BEFORE USE

GASOLINE ENGINES

☞ Use in open space, air swept or vent exhaust gases, which contain the deathly carbone oxyde, far from the work area.

DIESEL ENGINES

☞ Use in open space, air swept or vent exhaust gases far from the work area.

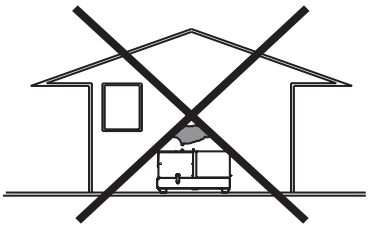

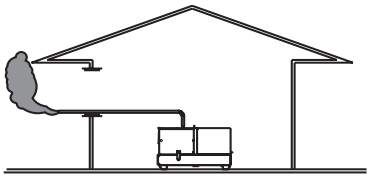

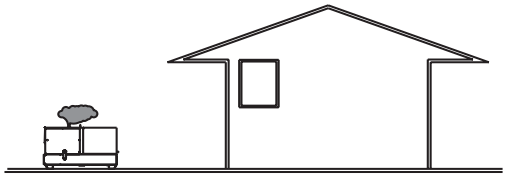

POSITION

Place the machine on a level surface at a distance of at least 1,5 m from buildings or other plants.

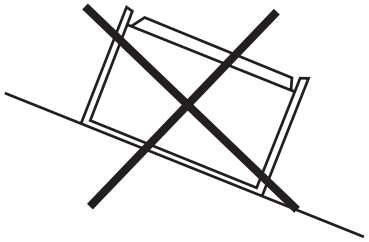

Maximum leaning of the machine (in case of dislevel)

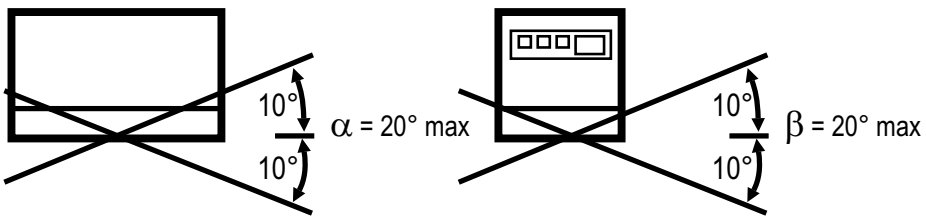

Check that the air gets changed completely and the hot air sent out does not come back inside the set so as to cause a dangerous increase of the temperature.

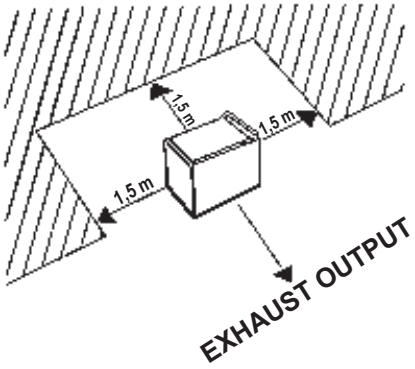

☞ Make sure that the machine does not move during the work: **block** it possibly with tools and/or devices made to this purpose.

MOVES OF THE MACHINE

☞ At any move check that the engine is **off**, that there are no connections with cables which impede the moves.

PLACE OF THE MACHINE

ATTENTION

For a safer use from the operator **DO NOT** fit the machine in locations with high risk of flood.
Please do not use the machine in weather conditions which are beyond IP protection shown both in the data plate and on page named "technical data" in this same manual.

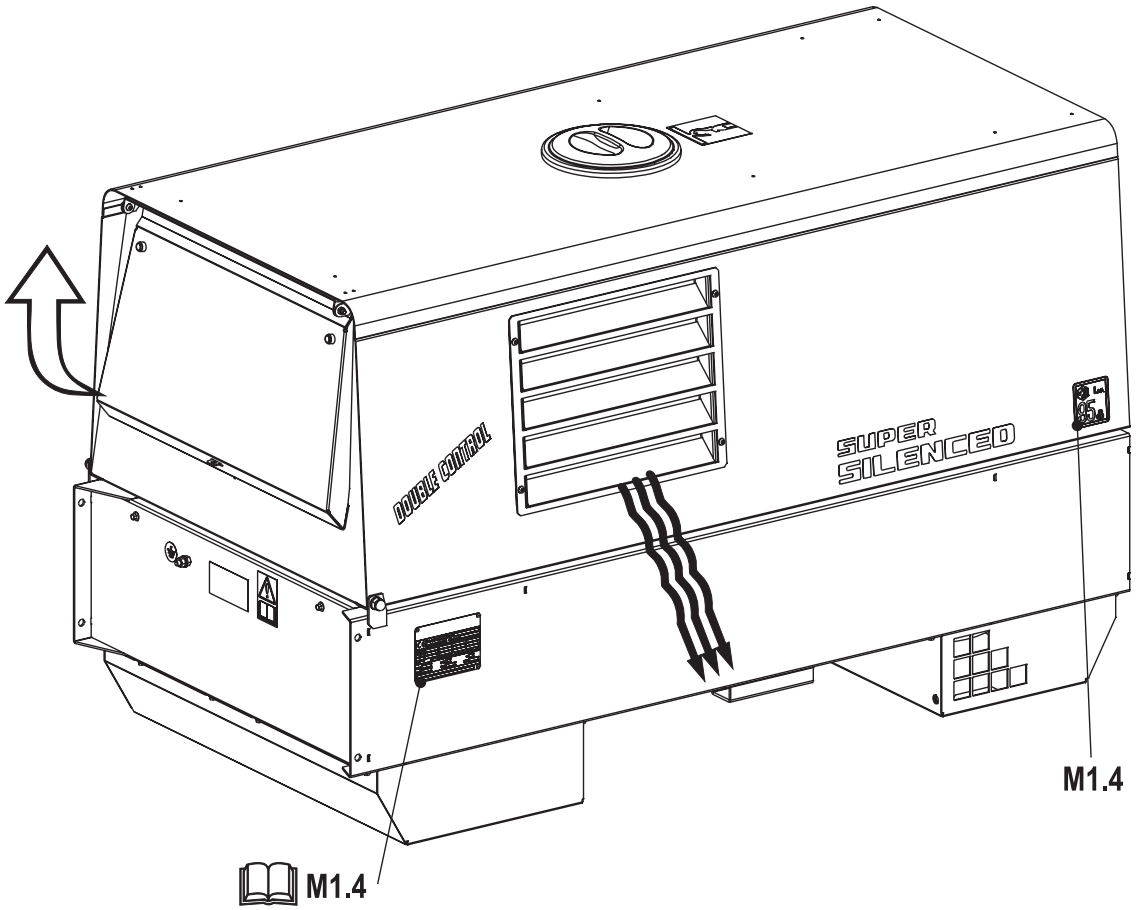
DOUBLE CONTROL
SUPER SILENCED
M1.4
M1.4

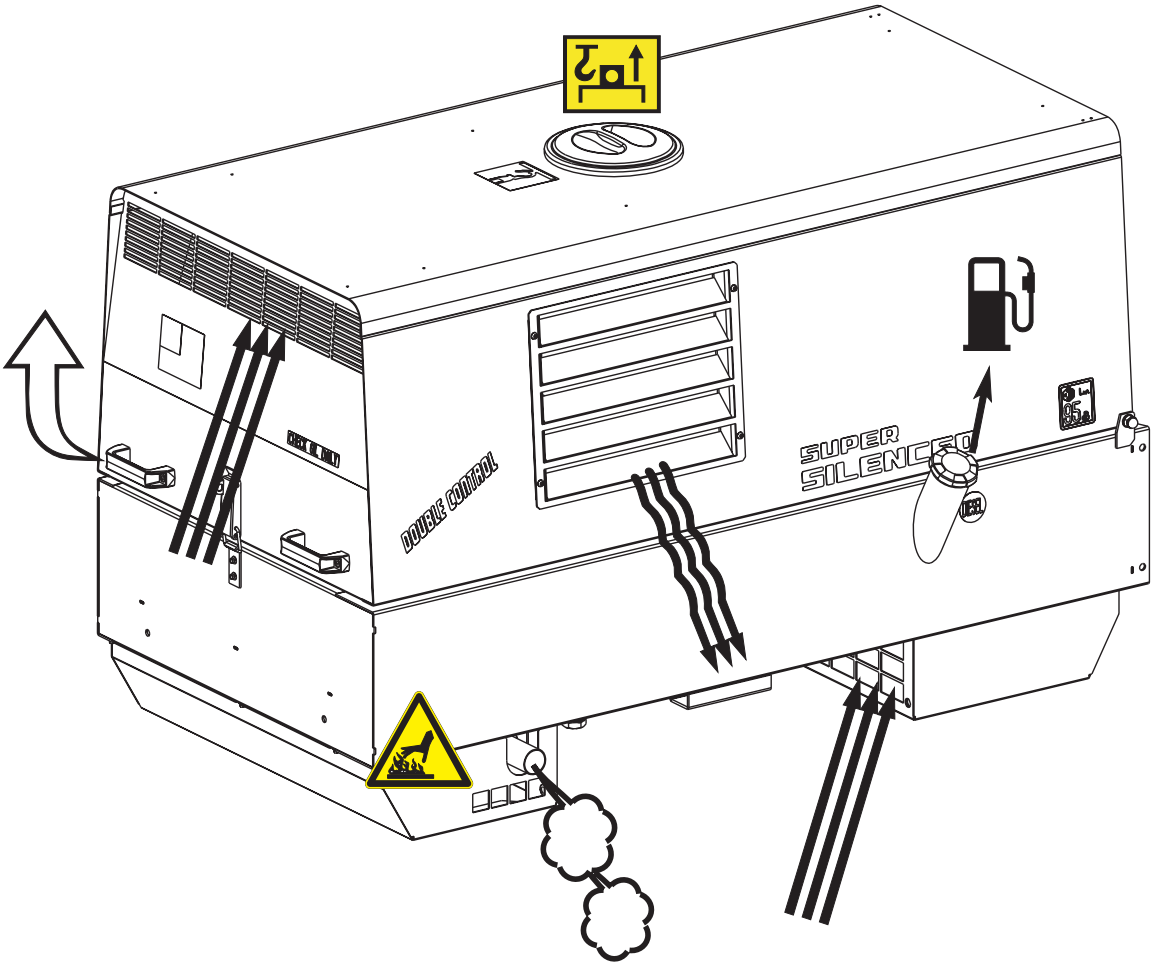
DOUBLE CONTROL
SUPER SILENCED

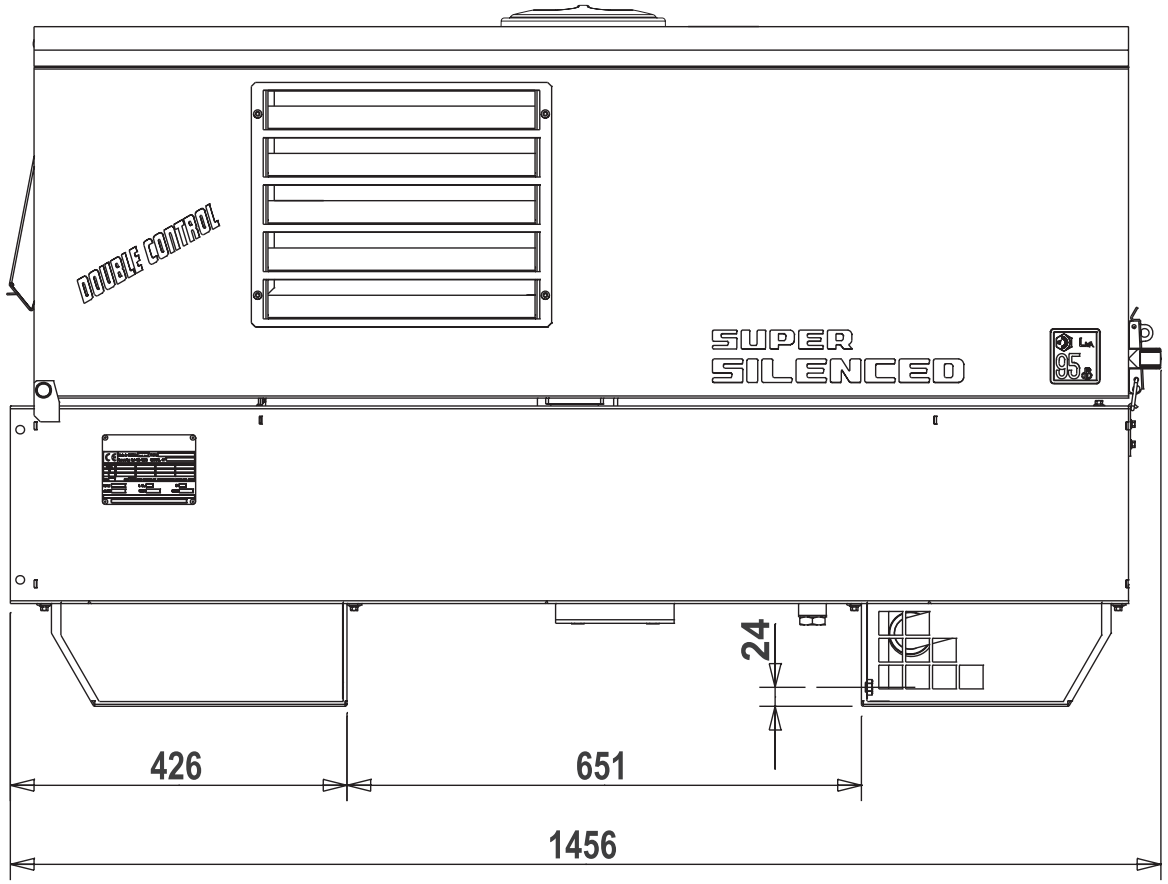
DOUBLE CONTROL
SUPER
SILENCED
95
24
426
651
1456

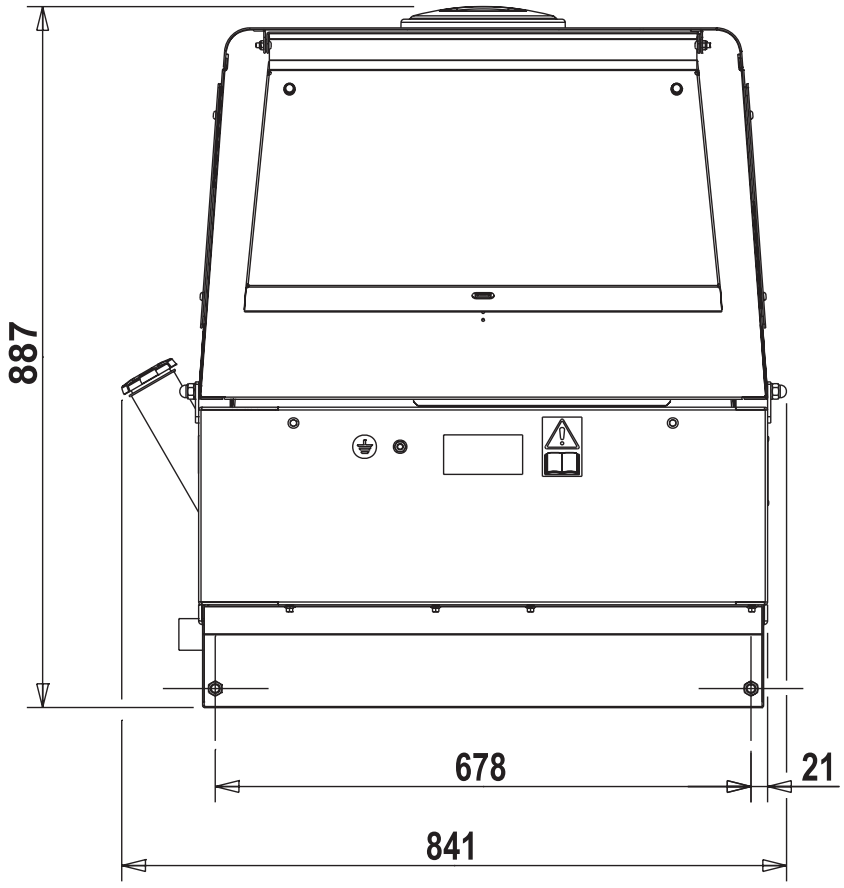
887
678
21
841

NOTE



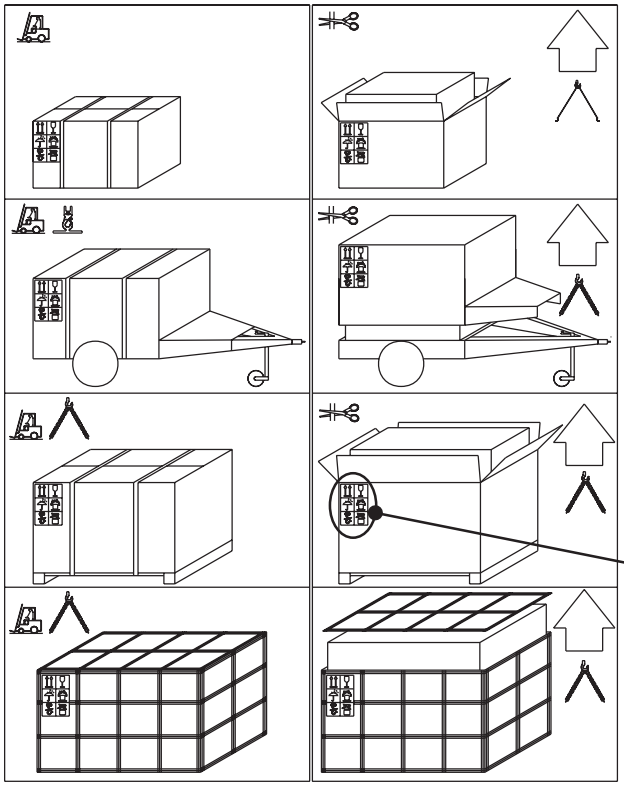

☞ Be sure that the lifting devices are: correctly mounted, adequate for the weight of the machine with it's packaging, and conforms to local rules and regulations.
When receiving the goods make sure that the product has not suffered damage during the transport, that there has not been rough handling or taking away of parts contained inside the packing or in the set.
In case you find damages, rough handling or absence of parts (envelopes, manuals, etc.), we advise you to inform immediately our Technical Service.

For eliminating the packing materials, the User must keep to the norms in force in his country.

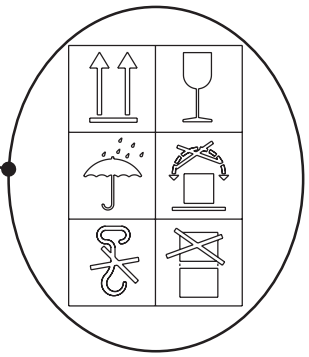

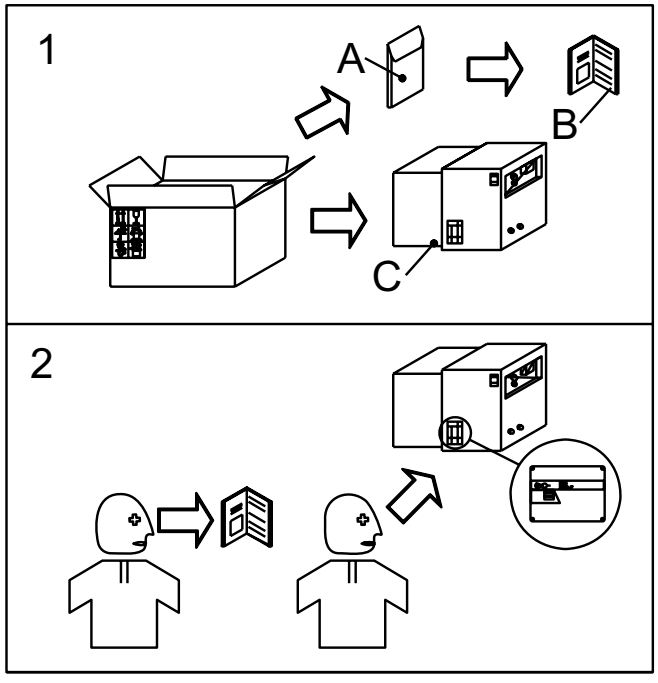

1) Take the machine (C) out of the shipment packing. Take out of the envelope (A) the user's manual (B).
2) Read: the user's manual (B), the plates fixed on the machine, the data plate.

NOTE

Transportation must always take place with the engine off, electrical cables and starting battery disconnected and fuel tank empty.
Be sure that the lifting devices are: correctly mounted, adequate for the weight of the machine with it's packaging, and conform to local rules and regulations.
Only authorized persons involved in the transport of the machine should be in the area of movement.

DO NOT LOAD OTHER PARTS WHICH CAN MODIFY WEIGHT AND BARICENTER POSITION.
IT IS STRICTLY FORBIDDEN TO DRAG THE MACHINE MANUALLY OR TOW IT BY ANY VEHICLE (model with no CTL accessory).
If you did not keep to the instructions, you could damage the structure of the machine.

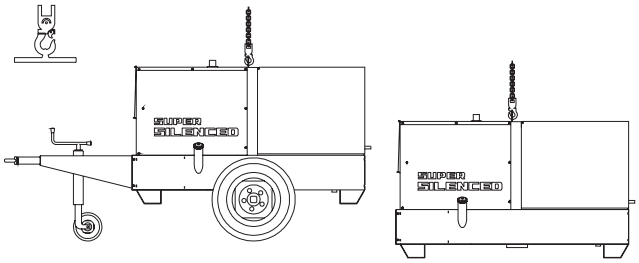

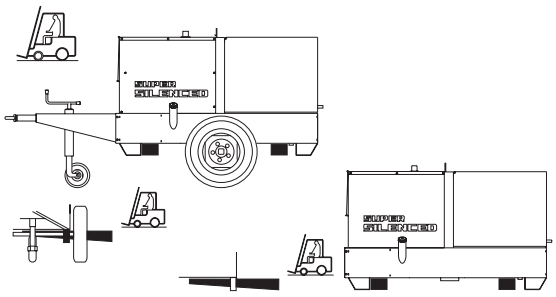

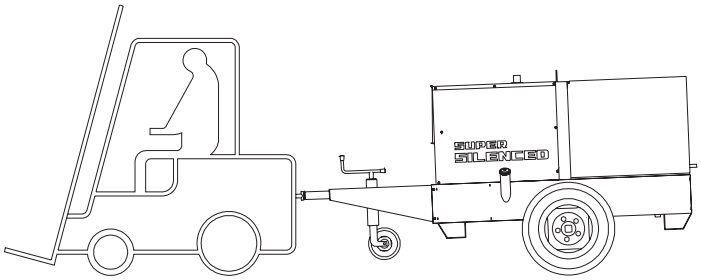

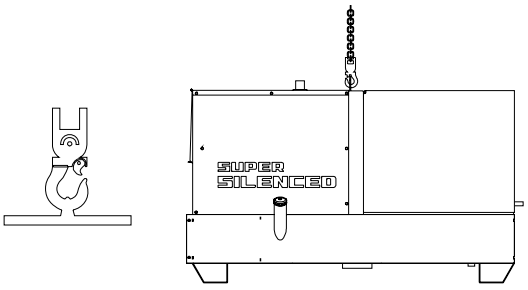

LIFT ONLY THE MACHINE

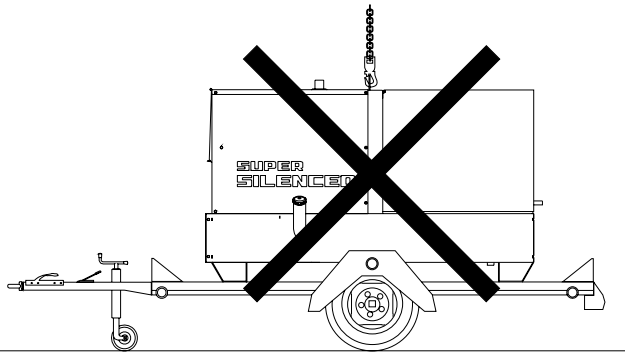

DO NOT LIFT THE MACHINE AND TRAILER

DANGER: LIFTING EYE IS NOT DESIGNED TO SUPPORT ADDED WEIGHT OF ROAD TOW TRAILER

⚠ ATTENTION

The CTL accessory cannot be removed from the machine and used separately (actioned manually or following vehicles) for the transport of loads or anyway for used different from the machine movements.

TRAILERS

The machines provided for assembling the CTL accessory (slow towing trolley) can be towed up to a **maximum** speed of **40 Kms/hour** on asphalted surfaces.

Towing on public roads or turnpikes of any type **IS EXCLUDED**, because **not** in possesion of the requirements by national and foreign traffic norms.

***Nota*:** Lift the machine and assemble the parts as shown in the drawing

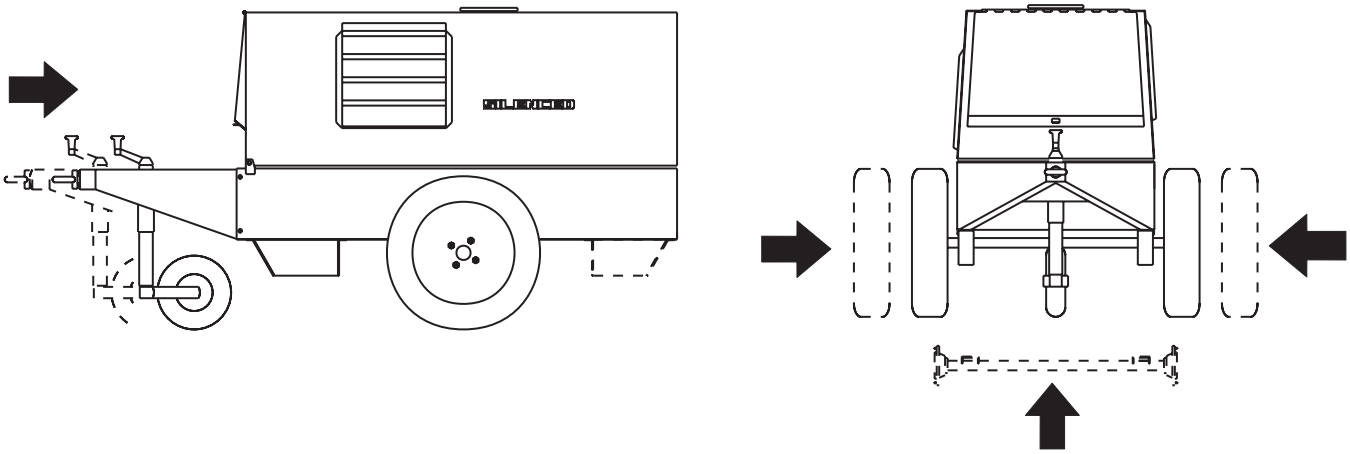

For assembling the generating set on the trolley CTL400 please keep to following instructions:

1) - Lift the generating set (by means of suitable hook).
2) - Slightly fix the jaw (3) of the parking foot to the bar with the M10x20 screws, the M10 nuts and the washers (so as to let the foot sprag go through.
3) - Split (unscrewing them) the two parts of the foot (4S-4I) to be able later to assemble them on the jaw.
4) - Introduce into the jaw (3) the upper part (4S) of the foot and screw again the lower part (4I), then tighten the screws (4V) of the jaw to the towbar and block momentaneously with the lever (4L) the whole foot.
5) - Assemble on the machine the towbar (5) complete of foot with the M10x20 screws, nuts and washers (see fig. page M6.2).
6) - Assemble the axle (7) to the base of the machine (see fig. page M6.2) with the M 10x20 screws and relative washers (two per part) so that their supports coincide.
8) - Insert the wheel (9) on the axle then screw the self blocking nuts (8).
9) - Pump the tyre (9) bringing the pressure to four atms.
10) - Lower the machine to the ground and place the parking foot definitively (regulating at the best height).

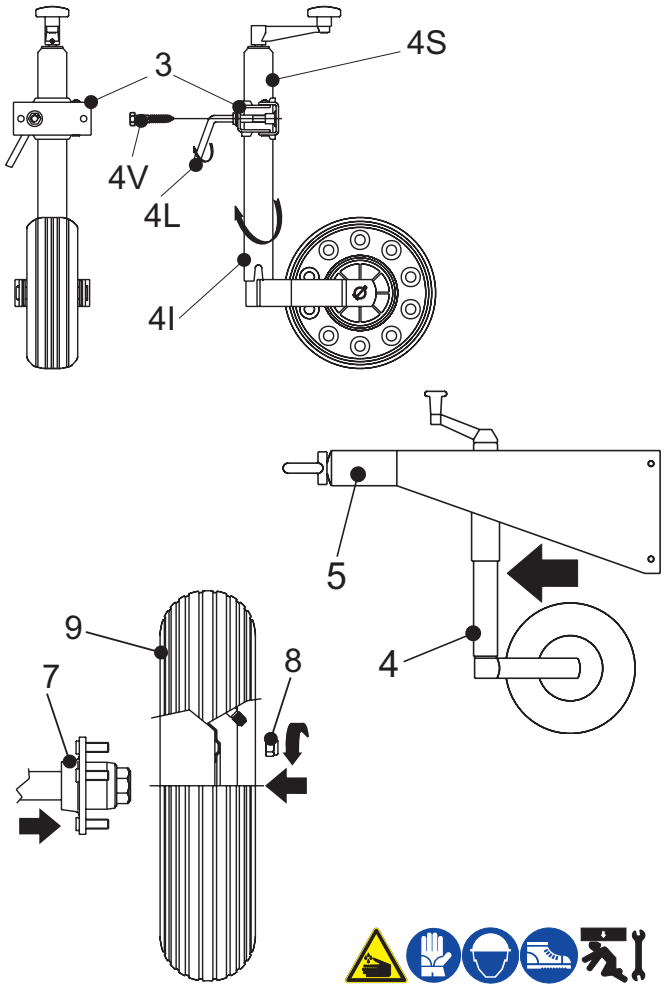

⚠ **ATTENTION**

Do not substitute the original tires with other types.

BATTERY WITHOUT MAINTENANCE

Connect the cable + (positive) to the pole + (positive) of the battery (after having taken away the protection), by properly tightening the clamp.

Check the state of the battery from the colour of the warning light which is in the upper part.

- Green colour: battery OK
- Black colour: battery to be recharged
- White colour: battery to be replaced

DO NOT OPEN THE BATTERY.

LUBRICANT

RECOMMENDED OIL

MOSA recommends selecting **AGIP** engine oil. Refer to the label on the motor for the recommended products.

PRODOTTI RACCOMANDATI RECOMMENDED PRODUCTS	
AGIP SIGMA TURBO PLUS 15W/40 API CG4 - ACEA E3	OLIO MOTORE DIESEL DIESEL ENGINE OIL
AGIP SUPERMOTOROIL 20W/50 API CC-SF	OLIO MOTORE BENZINA GASOLINE ENGINE OIL
AGIP ANTIFREEZE EXTRA INIBITE ETHYLENE GLYCOL (50% + 50% + H_2O)	CIRCUITO DI RAFFREDDAMENTO COOLING CIRCUIT (CUNA NC 956-16 ED 97)

Please refer to the motor operating manual for the recommended viscosity.

REFUELLING AND CONTROL:

Carry out refuelling and controls with motor at level position.

1. Remove the oil-fill tap (24)
2. Pour oil and replace the tap
3. Check the oil level using the dipstick (23); the oil level must be comprised between the minimum and maximum indicators.

ATTENTION

It is dangerous to fill the motor with too much oil, as its combustion can provoke a sudden increase in rotation speed.

DRY AIR FILTER

Check that the dry air filter is correctly installed and that there are no leaks around the filter which could lead to infiltrations of non-filtered air to the inside of the motor.

OIL BATH AIR FILTER

Fill the air filter using the same engine oil up to the level indicated on the filter.

FUEL

ATTENTION

Do not smoke or use open flames during refuelling operations, in order to avoid explosions or fire hazards.
Fuel fumes are highly toxic; carry out operations outdoors only, or in a well-ventilated environment.

Avoid accidentally spilling fuel. Clean any eventual leaks before starting up motor.

Refill the tank with good quality diesel fuel, such as automobile type diesel fuel, for example.

For further details on the type of diesel fuel to use, see the motor operating manual supplied.

Do not fill the tank completely; leave a space of approx. 10 mm between the fuel level and the wall of the tank to allow for expansion.

In rigid environmental temperature conditions, use special winterized diesel fuels or specific additives in order to avoid the formation of paraffin.

GROUNDING CONNECTION

The grounding connection to an earthed installation **is obligatory** for all models equipped with a differential switch (circuit breaker). In these groups the generator star point is generally connected to the machine's earthing; by employing the TN or TT distribution system, the differential switch guarantees protection against indirect contacts.
In the case of powering complex installations requiring or employing additional electrical protection devices, the coordination between the protection devices must be verified.
For the grounding connection, use the terminal (12); comply to local and/or current regulations in force for electrical installations and safety.

Check daily

NOTE

Do not alter the primary conditions of regulation and do not touch the sealed parts.

The starting of the unit can be effected in 3 different modes:

1) Start with EP6 key (Engine Control)

Put the "Local/Remote" selector on Local. Turn the key on "ON", the EP6 display shows, only on the machines with mounted glow plugs for 5 secs, the symbol "UUUU", then the message "Sta" appears the engine can be started, for then turn the key on "start" and start the engine.

On the display the word "Sta" remains for about 20 sec then automatically disappears; the engine **must be** started within 20 secs, otherwise the EP6 blocks the starting and on the display the word "fail" appears. Turning the key on "OFF" the EP6 is reset and a new starting cycle can be fixed.

Stop:

it is COMPULSORY to disconnect the load first, then to stop the engine turn the key on "OFF".

2) **Remote starting with TCM35**

Put the "Local/Remote" selector on Local. Connect TCM35 to the plug on the front panel and put the switch on "0".

Turn the key on ON in the EP6, wait for the various signals to go out then press the button "AUTO" in the EP6 until the led "AUTO" flashes.

Shift the switch on "I" in the TCM35 and automatically the starting cycle will start. On the machines with mounted glow plugs appears in the display EP6 (for about 5 secs), the symbol "UUUU"; the starting cycle includes 3 starting trials.

When the engine starts the led "AUTO" remains lit continuously and simultaneously the red warning light will light in the TCM35.

Stop:

it is COMPULSORY to disconnect the load first, then shift the switch of the TCM35 on "0", the engine will stop immediately.

3) **Start with Automatic start unit (EAS)**

Put the "Local/Remote" selector on Remote. Connect the EAS to unit.

The EAS controls the starting as well as the stop of the engine.

Follow attentively the instructions reported in the EAS manual. In these conditions the EP6 has the only function to measure the electric values, hour-meter, etc.

CAUTION

MACHINE WITH EMERGENCY BUTTON

Pressing the button the engine will stop immediately in any working condition.

Turn clockwise to reset the button.

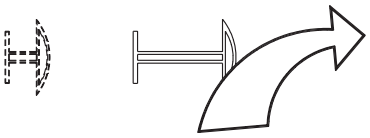

CAUTION

RUNNING-IN

During the first 50 hours of operation, do not use more than 60% of the maximum output power of the unit and check the oil level frequently, in any case please stick to the rules given in the engine use manual.

NOTE

For safety reason the key must be kept by qualified personel.

4A	Hydraulic oil level light
9	Welding socket (+)
10	Welding socket (-)
12	Earth terminal
15	A.C. socket
16	Accelerator lever
17	Feed pump
19	48V D.C. socket
22	Engine air filter
23	Oil level dipstick
24	Engine oil reservoir cap
24A	Hydraulic oil reservoir cap
24B	Water filling cap
25	Fuel prefilter
26	Fuel tank cap
27	Muffler
28	Stop control
29	Engine protection cover
30	Engine cooling/alternator fan belt
31	Oil drain tap
31A	Hydraulic oil drain tap
31B	Water drain tap
31C	Exhaust tap for tank fuel
32	Button
33	Start button
34	Booster socket 12V
34A	Booster socket 24V
35	Battery charge fuse
36	Space for remote control
37	Remote control
42	Space for E.A.S.
42A	Space for PAC
47	Fuel pump
49	Electric start socket
54	Reset button PTO HI
55	Quick coupling m. PTO HI
55A	Quick coupling f. PTO HI
56	Hydraulic oil filter
59	Battery charger thermal switch
59A	Engine thermal switch
59B	Aux current thermal switch
59C	Supply thermal switch wire feeder-42V
59D	Pre-heater (spark plug) thermal switch
59E	Supply thermal switch oil/water heather
59F	Electropump thermal switch
63	No load voltage control
66	Choke control
67A	Auxiliary / welding current control
68	Cellulosic electrodes control
69A	Voltmeter relay
70	Warning lights
71	Selecting knob
72	Load commut. push button
73	Starting push button
74	Operating mode selector
75	Power on warning light
76	Display
79	Wire connection unit
86	Selector
86A	Setting confirmation
87	Fuel valve
88	Oil syringe
A3	Insulation monitoring
A4	Button indicating light 30 l/1' PTO HI
B2	Engine control unit EP2
B3	E.A.S. connector
B4	Exclusion indicating light PTO HI
B5	Auxiliary current push button
C2	Fuel level light
C3	E.A.S. PCB
C6	Control unit for generating sets QEA
D	Ground fault interrupter (30 mA)
D1	Engine control unit and economiser EP1
D2	Ammeter
E2	Frequency meter
E6	Frequency rpm regulator
E7	Voltmeter regulator
F	Fuse
F3	Stop switch
F5	Warning light, high temperature
F6	Arc-Force selector
G1	Fuel level transmitter
H2	Voltage commutator
H6	Fuel electro pump
H8	Engine control unit EP7
I2	48V A.C. socket
I3	Welding scale switch
I4	Preheating indicator
I5	Y/▲ switch
I6	Start Local/Remote selector
I8	AUTOIDLE switch
L	A.C. output indicator
L5	Emergency button
L6	Choke button
M	Hour counter
M1	Warning level light
M2	Contactor
M5	Engine control unit EP5
M6	CC/CV switch
N	Voltmeter
N1	Battery charge warning light
N2	Thermal-magnetic circuit breaker/ Ground fault interrupter
N5	Pre-heat push-button
N6	Connector - wire feader
O1	Oil pressure warning light/Oil alert
P	Welding arc regulator
P8	Water in fuel
Q1	Starter key
Q3	Derivation box
Q4	Battery charge sockets
Q7	Welding selector mode
R3	Siren
S	Welding ammeter
S1	Battery
S3	Engine control unit EP4
S6	Wire feeder supply switch
S7	Plug 230V singlephase
T	Welding current regulator
T4	Dirty air filter warning light/indicator
T5	Earth leakage relay
T7	Analogic instrument V/Hz
U	Current trasformer
U3	R.P.M. adjuster
U4	Polarity inverter remote control
U5	Relase coil
U7	Engine control unit EP6
V	Welding voltage voltmeter
V4	Polarity inverter control
V5	Oil pressure indicator
W1	Remote control switch
W3	Selection push button 30 l/1' PTO HI
W5	Battery voltmeter
X1	Remote control socket
Y3	Button indicating light 20 l/1' PTO HI
Y5	Commutator/switch, serial/parallel
Z2	Thermal-magnetic circuit breaker
Z3	Selection push button 20 l/1' PTO HI
Z5	Water temperature indicator

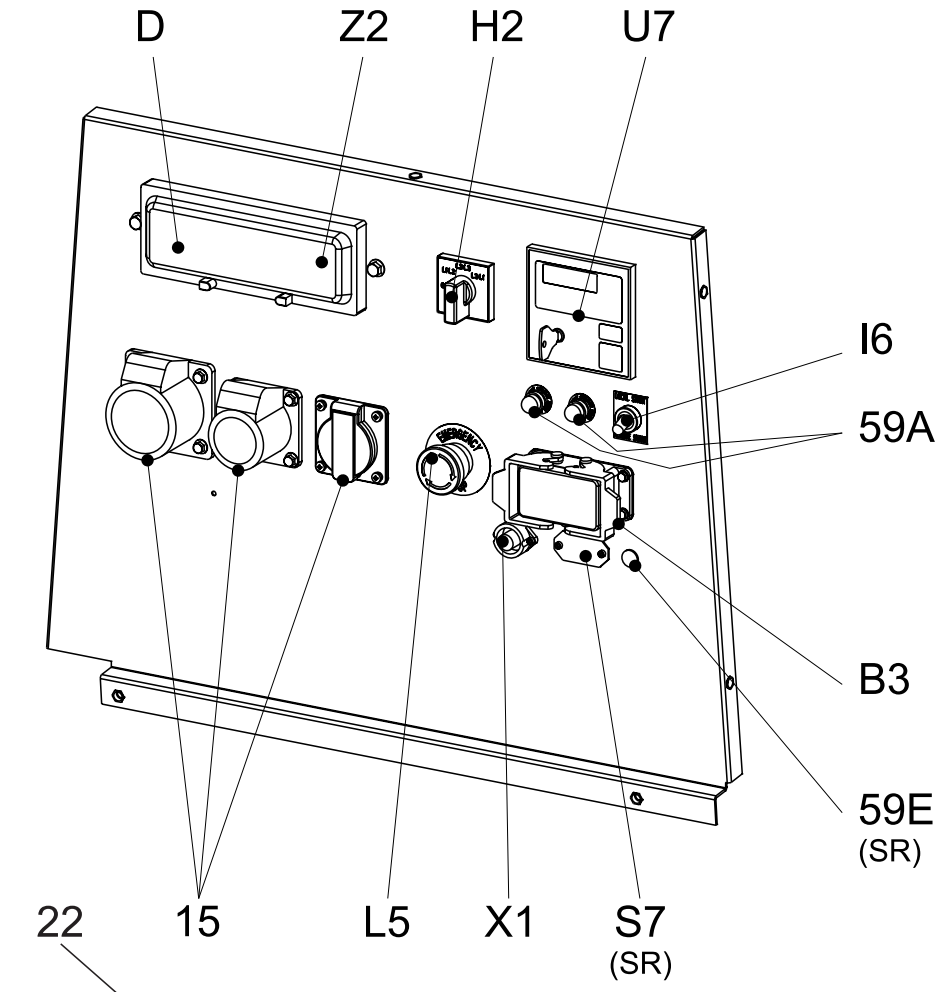
D
Z2
H2
U7
I6
59A
B3
59E
(SR)
22
15
L5
X1
S7
(SR)

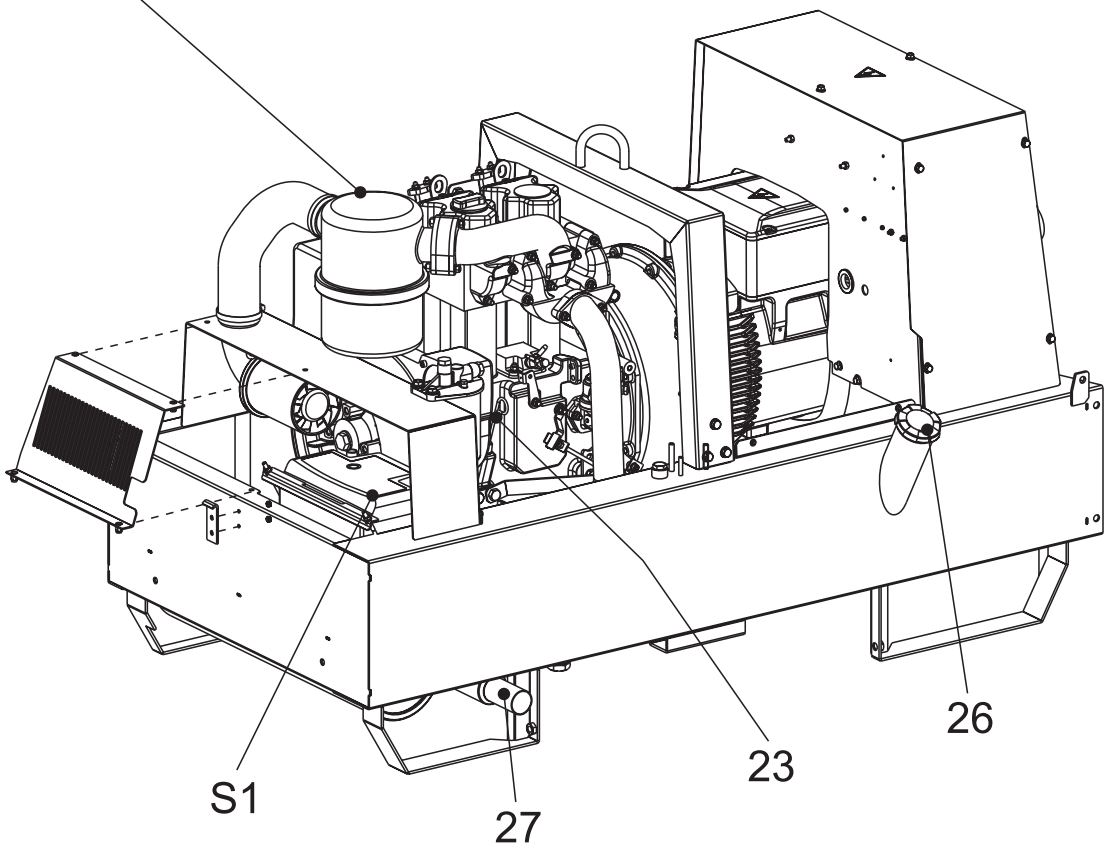
S1
27
23
26

Z2	Thermal-magnetic circuit breaker	General switch for the gen-set. It protects both gen-set and related electrical circuit from over current /short circuit.
D	Ground fault interrupter (30 mA)	Device for protection against not-direct contacts for TN and TT systems (neutral grounded to frame)
12	Earth terminal	Ground connection point for gen-set.
15	A.C. socket	AUX sockets for load connection.
U7	Engine control unit EP6	Engine control unit. Genset stop/ start. Handling of generator alarms. display of alarms, Voltage, Hz, hour counter, Amps, battery voltage, operation messages.
I6	Start Local/Remote selector	Selection of engine control in use. Local start: control on board, EP6 operated. Remote start: external control, EAS operated.
H2	Voltage commutator	Selection of visualized line voltage.
59A	Engine thermal switch	Protection against over-currents and short circuits in the engine electrical system.
L5	Emergency button	To be pushed in case of danger. Immediate stop of the gen-set.
X1	Remote control socket	Connection for TCM35 remote control or for a NO clean contact, both operating only if EP6 is set to AUTO.
B3	E.A.S. connector	Connection for automatic intervention unit (AMF + ATS). 16 pin connector.
S7 (SR)	Plug 230V singlephase	External supply for engine heater (mains).
59E	Supply thermal switch oil/water heather	Protection against over-current & short circuit of the engine heater.
R3	Siren	Gen-set acoustic alarm.
E7 (SR)	Voltage regulator / potentiometer	Regulation of output voltage.

WARNING

It is absolutely forbidden to connect the unit to the public mains and/or another electrical power source .

Access <u>forbidden</u> to area adjacent to electricity-generating group for all non-authorized personnel.

WARNING

For the canopy generator sets provided with doors, the following instruction shall be observed. During the normal operation, the doors of the engine compartment and/or the electrical box shall be kept closed, locked up if possible, as they must be considered in all respects as protection barriers. The access to the internal parts shall occur for maintenance purposes only, by qualified personnel and, in any case, when the engine is stopped.

The electricity-generating groups are to be considered electrical energy producing stations.
The dangers of electrical energy must be considered together with those related to the presence of chemical substances (fuels, oils, etc.), rotating parts and waste products (fumes, discharge gases, heat, etc.).

GENERATION IN AC (ALTERNATING CURRENT)

Before each work session check the efficiency of the ground connection for the electricity-generating group if the distribution system adopted requires it, such as, for example, the TT and TN systems.

Check that the electrical specifications for the units to be powered - voltage, power, frequency - are compatible with those of the generator. Values that are too high or too low for voltage and frequency can damage electrical equipment irreparably.
In some cases, for the powering of three-phase loads, it is necessary to ensure that the cyclic direction of the phases corresponds to the installation's requirements.

Connect the electric devices to be powered to the AC sockets, using suitable plugs and cables in prime condition.

Before starting up the group, make certain no dangerous situations exist on the installation to be powered.
Check that the thermal-magnetic switch (Z2) is in the OFF position (input lever in downward position).

Start up the electricity-generating group, positioning the thermal-magnetic switch (Z2) and differential switch (D) to ON (input lever in upward position).
Before powering on the utilities, check that the voltmeter (N) and frequency meter (E2) indicate nominal values; in addition, check on the voltmeter change-over switch (H2) (where it is assembled) that the three line voltages are the same.
☞ In the absence of a load, the values for voltage and frequency can be greater than their nominal values. See sections on VOLTAGE and FREQUENCY.

OPERATING CONDITIONS

<u>POWER</u>

The electrical power expressed in kVA on an electricity-generating group is the available output power to the reference environmental conditions and nominal values for: voltage, frequency, power factors (cos φ).
There are various types of power: PRIME POWER (PRP), STAND-BY POWER established by ISO 8528-1 and 3046/1 Norms, and their definitions are listed in the manual's TECHNICAL SPECIFICATIONS page.

☞ During the use of the electricity-generating group **NEVER EXCEED** the power indications, paying careful attention when several loads are powered simultaneously.

<u>VOLTAGE</u>

GENERATORS WITH COMPOUND SETTING (THREEPHASE)
GENERATORS WITH CONDENSER SETTING (SINGLEPHASE)
In these types of generators, the no-load voltage is generally greater than 3–5% with respect to its nominal value; f.e. for nominal voltage, threephase 400Vac or singlephase 230Vac, the no-load voltage can be comprised between 410-420V (threephase) and 235-245V (singlephase). The precision of the load voltage is maintained within ±5% with balanced loads and with a rotation speed variation of 4%. Particularly, with resistive loads (cos φ = 1), a voltage over-elevation occurs which, with the machine cold and at full load, can even attain +10 %, a value which in any case is halved after the first 10-15 minutes of operation.
The insertion and release of the full load, under constant rotation speed, provokes a transitory voltage variation that is less than 10%; the voltage returns to its nominal value within 0.1 seconds.

GENERATORS WITH ELECTRONIC SETTING (A.V.R.)
In these types of generators, the voltage precision is maintained within ±1,5%, with speed variations comprised from -10% to +30%, and with balanced loads. The voltage is the same both with no-load and with load; the insertion and release of the full load provokes a transitory voltage variation that is less than 15%; the voltage returns to its nominal value within 0.2–0.3 seconds.

<u>FREQUENCY</u>

The frequency is a parameter that is directly dependent on the motor's rotation speed. Depending on the type of alternator, 2 or 4 pole, we will have a frequency of 50/60 Hz with a rotation speed of 3000/3600 or 1500/1800 revolutions per minute.

The frequency, and therefore the number of motor revolutions, is maintained constant by the motor's speed regulation system.
Generally, this regulator is of a mechanical type and presents a droop from no-load to nominal load which is less than 5 % (static or droop), while under static conditions precision is maintained within ±1%.Therefore, for generators at 50Hz the no-load frequency can be 52–52.5 Hz, while for generators at 60Hz the no-load frequency can be 62.5-63Hz.
In some motors or for special requirements the speed regulator is electronic; in these cases, precision under static operating conditions attains ±0.25%, and the frequency is maintained constant in operation from no-load to load (isochronal operation).

POWER FACTOR - COS φ

The power factor is a value which depends on the load's electrical specifications; it indicates the ratio between the Active Power (kW) and Apparent Power (kVA). The apparent power is the total power necessary for the load, achieved from the sum of the active power supplied by the motor (after the alternator has transformed the mechanical power into electrical power), and the Reactive Power (kVAR) supplied by the alternator. The nominal value for the power factor is cos φ = 0,8; for different values comprised between 0.8 and 1 it is important during usage not to exceed the declared active power (kW), so as to not overload the electricity-generating group motor; the apparent power (kVA) will diminish proportionally to the increase of cos φ.
For cos φ values of less than 0.8 the alternator must be downgraded, since at equal apparent power the alternator should supply a greater reactive power. For reduction coefficients, contact the Technical Service Department.

START-UP OF ASYNCHRONOUS MOTORS

The start-up of asynchronous motors from an electricity-generating group can prove critical because of high start-up currents the asynchronous motor requires (I start-up = up to 8 times the nominal current In.). The start-up current must not exceed the alternator's admissible overload current for brief periods, generally in the order of 250–300% for 10–15 seconds.
To avoid a group oversize, we recommend following these precautionary measures:
- in the case of a start-up of several motors, subdivide the motors into groups and set up their start-up at intervals of 30–60 seconds.
- when the operating machine coupled to the motor allows it, see to a start-up with reduced voltage, star point/triangle start-up or with autotransformer, or use a soft-start system.

In all cases, when the user circuit requires the start-up of an asynchronous motor, it is necessary to check that there are no utilities inserted into the installation, which in the case of a voltage droop can cause more or less serious disservices (opening of contact points, temporary lack of power to control and command systems, etc.).

SINGLE-PHASE LOADS

Power to monophase utilities by means of three-phase generators requires some operating limitations.
- In single-phase operation, the declared voltage tolerance can no longer be maintained by the regulator (compound or electronic regulator), since the system becomes highly unbalanced. **The voltage variation on the phases not affected by the power can prove dangerous; we recommend sectioning the other loads eventually connected**.
- The maximum power which can be drawn between Neutral and Phase (start connection) is generally 1/3 of the nominal three-phase power; some types of alternators even allow for 40%. Between two Phases (triangle connection) the maximum power cannot exceed 2/3 of the declared three-phase power.
- In electricity-generating groups equipped with monophase sockets, use these sockets for connecting the loads. In other cases, always use the "R" phase and Neutral.

ELECTRIC PROTECTIONS

THERMAL-MAGNETIC SWITCH

The electricity-generating group is protected against short-circuits and against overloads by a thermal-magnetic switch (Z2) situated upstream from the installation. Operating currents, both thermic and magnetic, can be fixed or adjustable in relation to the switch model.



☞ In models with adjustable operating current **do not modify** the settings, since doing so can compromise the installation's protection or the electricity-generating group's output characteristics. For eventual variations, contact our Technical Service Department.
The intervention of the protection feature against overloads is not instantaneous, but follows a current overload/time outline; the greater the overload the less the intervention. Furthermore, keep in mind that the nominal operating current refers to an operating temperature of 30°C, so that each variation of 10°C roughly corresponds to a variation of 5% on the value of nominal current.

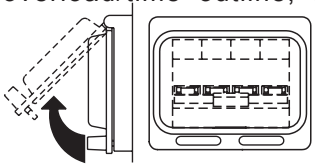

In case of an intervention on the part of the thermal magnetic protection device, check that the total absorption does not exceed the electricity-generating group's nominal current.

DIFFERENTIAL SWITCH

The differential switch or differential relay guarantee protection against indirect contacts due to malfunction currents towards the ground. When the device detects a malfunction current that is higher than the nominal current or the set current, it intervenes by cutting off power to the circuit connected.

In the case of an intervention

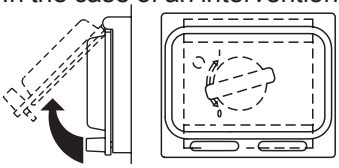



by the differential switch, check that there are no sheathing defects in the installation: connection cables, sockets and plugs, utilities connected.

☞ Before each work session, check the operation of the differential protection device by pressing the test key. The electricity-generating group must be in operation, and the lever on the differential switch must be in the ON position.

THERMIC PROTECTION

Generally present to protect against overloads on an individual power socket c.a.

When the nominal operating current has been exceeded, the protection device intervenes by cutting off power to the socket.

The intervention of the protection device against overloads is not instantaneous, but follows a current overload/time outline; the greater the overload the less the intervention.

In case of an intervention, check that the current absorbed by the load does not exceed the protection's nominal operating current.

Allow the protection to cool off for a few minutes before resetting by pressing the central pole.

ATTENTION

Do not keep the central pole on the thermic protection forcefully pressed to prevent its intervention.

USAGE WITH EAS AUTOMATIC START-UP PANEL

The electricity-generating group in combination with the EAS automatic start-up panel forms a unit for distributing electrical energy within a few seconds of a power failure from the commercial electrical power line.

Below is some general operating information; refer to the automatic panel's specific manual for details on installation, command, control and signalling operations.

- ❑ Perform connections on the installation in safety conditions. Position the automatic panel in RESET or LOCKED mode.
- ❑ Carry out the first start-up in MANUAL mode.
  Check that the generator's LOCAL START / REMOTE START switch (I6) is in the REMOTE position.
  Check that the generator switches are enabled (input lever in upward position).
  Position the EAS panel in manual mode by pressing MAN. key, and only after having checked that there are no dangerous situations, press the START key to start the electricity-generating group.
- ❑ During the operation of the generator, all controls and signals from both the automatic panel and group are enabled; it is therefore possible to control its operation from both positions.
  In case of an alarm with a shutdown of the motor (low pressure, high temperature, etc.), the automatic panel will indicate the malfunction that has caused the stoppage, while the generator's front panel will be disabled and will no longer supply any information.

MAKE SURE

➔ The selector LOCAL START/REMOTE START (I6) of the generating set must be switched on LOCAL-START.
➔ Put the selector „switch board (N7)“ on ON.

The coupling of the TCM 35 with the generating set, ready for remot starting, permits to work far from the set itself.
The remote control is connected to the front plate (X1), and/or rear plate, with a multiple connector.

N.B. The remote control TCM 35 can be used only with machines equipped with control and protection device EP6 (U7).

For use of TCM 35 see page M21 (start and stop) of this manual.

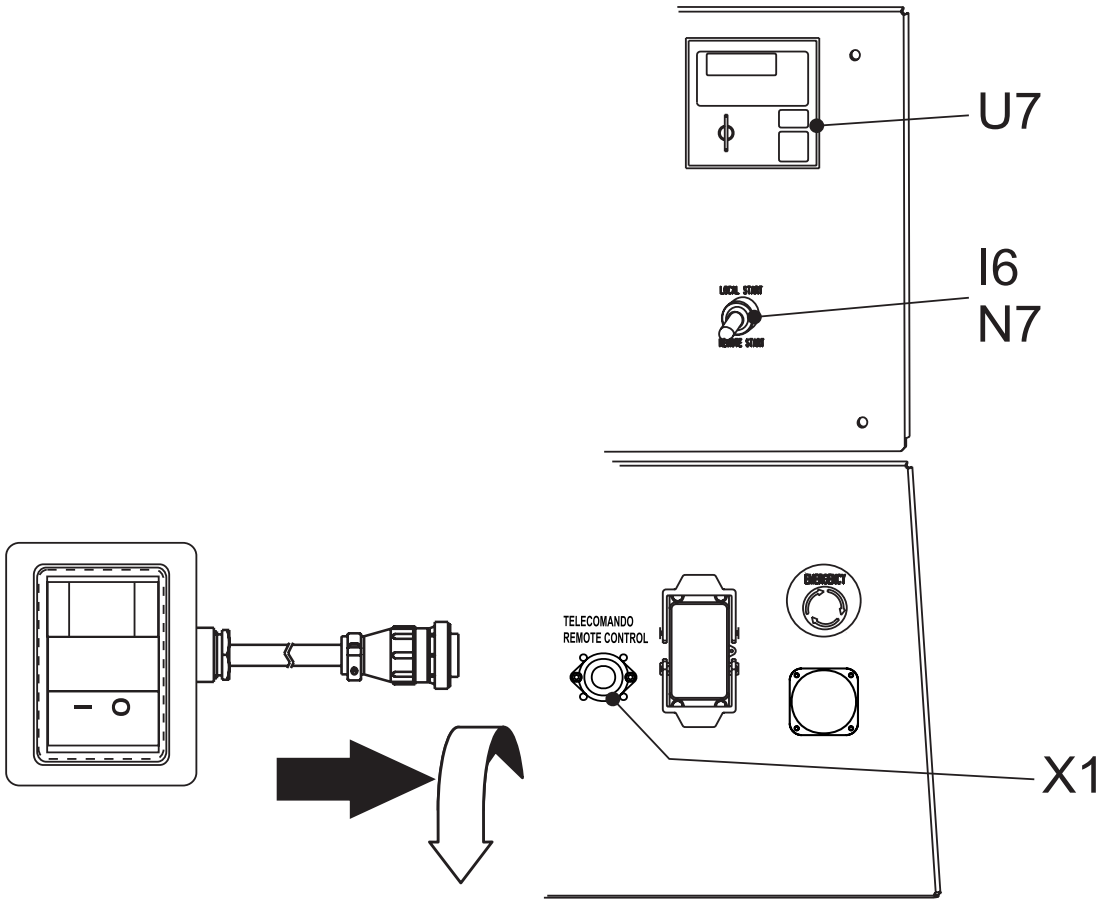

FRONT PANEL

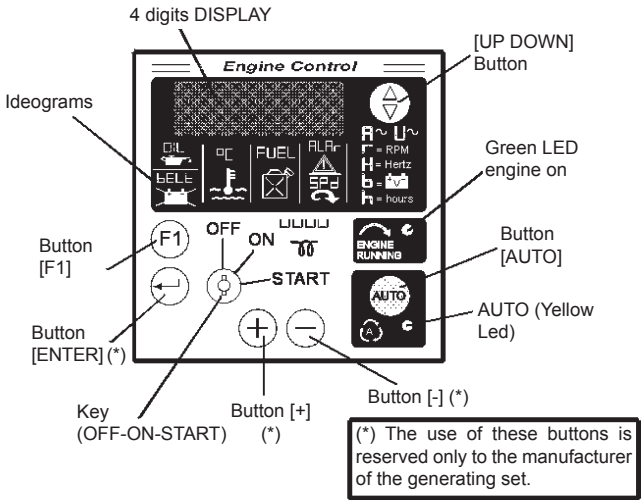

1.0 INTRODUCTION

The EP6 features Engine and Generating Set control and monitoring. The EP6 provides visual indication by means of LEDs (solid state lamps) and a Display (see section 10.0). It features OFF, MAN and AUTO operating modes. The display gives Messages for alarms and Measurement indications.

EP6 has programmable parameters. Please contact the producer of the generating set to receive instructions related to programming.

2.0 OPERATING MODE selection

The EP6 features AUTO (section 2.1), MANUAL (section 2.2) and OFF (section 2.3) operating modes. When the power supply is switched on, the EP6 behaves as follow:

A) if the KEY-SWITCH is in the ***OFF position,*** the EP6 enters the OFF operating mode.

B) if the KEY-SWITCH is in the ***ON position,*** the EP6 enters the AUTO operating mode. That is, if the EP6 was in AUTO prior to the supply removal. If not, the EP6 enters the MANUAL operating mode.

2.1 AUTO operating mode

To enter the "AUTO" operating mode use the following instructions:

A) - Turn ON the key switch: the Display and LEDs illuminate for 1 second.

B) - Wait for the end of the LAMP test, then push the AUTO pushbutton after the [UUUU] (Pre-glow) or [Sta-] (Start prompt) has been displayed. After this, the yellow Led AUTO will illuminate. If the REMOTE START input is not operative, the LED will flash. If operative, the LED illuminates continuously and a start cycle will take place (***NOTE***: the EP6 shuts down the display during the crank).

C) - In order to cancel the AUTO operating mode, push the AUTO pushbutton (the yellow Led will turn OFF) or turn the KEY-SWITCH to OFF. Once in AUTO, the EP6 waits for a REMOTE START activation (see section 7.0). In case of an Automatic Periodic Test (A.P.T.), the display will show the message [tESt].

2.2 MANUAL operating mode

To start the engine follow the instructions:

A) - Turn ON the KEY-SWITCH; the EP6 illuminates the LEDs and Display.

B) - If the display shows the message [uuuu], the EP6 is counting the PRE-GLOW time; wait until the message disappears.

C) - After the display shows the flashing message [StA-] (*NOTE*), turn the Key to START position (momentary position with spring-loaded return) until the engine starts. The message [. . . .] indicates a MANUAL start.

D) - To stop the engine, turn the KEY SWITCH to OFF.

NOTE: **EP6 shows the blinking [StA-] message for 20 seconds. After this time, if the engine does not start, the EP6 displays the message [FAIL] (Fail to start, see section 4.07).To clear the alarm, turn the KEY-SWITCH to OFF.**

2.3 OFF operating mode

This function is obtained by turning the KEY SWITCH to OFF. The OFF operating mode clears the fault alarms and shuts down the Display after 5 seconds. A blinking dot indicates the presence of the power supply. Press one of the pushbuttons to energize the display. In OFF operating mode, the EP6 allows reading of the parameters (see section 6.0).

3.0 DISPLAY features

The EP6 features a 4 Digit Display (section10.0) to show measurements, settings and error messages. The [UP-DOWN] pushbutton selects one of the following menus:

[AXXX] *(*)* Generator Current measurement
[UXXX] The Voltage of the Generating Set
[rPM] [XXXX] Speed of the engine
[HXX.X] Frequency of the Generator
[bXX.X] Battery Voltage
[cXX.X] Charger Alternator Voltage
[h] [XXXX] HOUR METER (the message **[h]** appears for a moment, and then, the counter will be displayed continuously).

(*): the symbol "X" means a numerical field.

4.0 ALARM messages

The alarms are displayed by means of messages. In case of alarm consult your Generating Set manufacturer. To remove the message, turn OFF the KEY-SWITCH. The EP6 may show one of the following:

[OIL]	Low Oil Pressure
[°C]	High Temperature
[O.SPd.]	Over Speed of the engine
[U.SPd]	Under Speed of the engine
[bELt]	Failure of the belt
[ALAr]	External Emergency Stop
[FUEL](1)	Low Fuel in the tank
[FAIL]	Starting Failure Alarm
[E 04]	Alternator Failure
[E 05](2)	Generator Overload
[Hi H](2)	Generator Over Frequency
[Lo H](2)	Generator Under Frequency
[Hi U] (2)	Generator Under Voltage
[Lo U](2)	Generator Under Voltage
[XX.X]	Battery Voltage
[Err]	Memory error

(1) [FUEL] This message indicates Low Fuel in the tank . The engine stops if the contacts remain closed for 5 minutes continuously.

(2) To determine the value that caused the failure, push the [F1] pushbutton.

4.1 OPERATING messages

EP6 features messages to inform you about the following:

[uuuu] Glow-plugs timing
[U—] Voltage out of range
[StA-] Start prompt
[. . . .] Starting by key switch
[rESt] Rest timing
[tESt] Automatic Test
[CAL] Calibration
[ProG] Programming
[StOP] Stopping cycle

5.0 LEDs for visual indication

The EP6 features two LEDs **(see section 10.0)** to indicate the following conditions:

[ENGINE RUNNING]: this green led illuminates when the engine is running.
[AUTO]: this yellow LED blinks to indicate a standby mode. The EP6 monitors the REMOTE CONTROL and expects a command. The LED illuminates continuously when the REMOTE START is activated.

5.1 LEDs and Display Test

A test of the LEDs and DISPLAY is obtained automatically anytime the key switch is turned ON. The LEDs and DISPLAY light up for about 1 second.

6.0 Parameters and settings

The unit is programmed by the supplier of the Generating Set. Contact the Generator manufacturer in order to have the permission to program the module. It is possible to read the status of the internal programming at anytime. Follow the instructions:

A) - Turn the Key in OFF (if the display indicates [STOP], wait until it disappears)
B) - Push the pushbutton [F1] the display will show the first programmable parameter **[P.0]**.
C) - Push the pushbutton [F1] the display will indicate the value of the parameter ([1"]).
D) - Push the pushbutton [UP-DOWN] to select a parameter. Push [F1] to display the setting.
E) - The display returns to menu mode if you have not used the pushbuttons for 2 minutes.

The list of the parameters follows (['] means minutes and ["] means seconds). Some parameters may differ according to the programming done by the genset manufacturer.

Display	Parameter [Default]
[P.0]	**Remote Start Delay Timing (Input #7) [1"]** Range: 1-59 secs or 1-15 mins Seconds or minutes of continuous REMOTE START command to initiate the automatic engine start (see section 7.0 and [P20] in this section).
[P.1]	**Remote Stop Delay Timing (Input #7) [1"]** Range: 1-59 secs or 1-15 mins Seconds or minutes of continuous absence of the REMOTE START command to initiate the stop cycle (see section 7.0 and [P.20] in this section).
[P.2]	**Crank Timing (Output #10) [5"]** Range:1-20 seconds Maximum insertion time of the *Starter Motor*.
[P.3]	**Engine Running Trigger (Input #1) [8.0]** Range: 3V-24V, [inh]. If the voltage of the Charger Alternator rises above the [setting], the *Starter Motor* is disconnected.
[P.4]	**Rest Timing [3"]** Range: 3-20 secs. Time interval between starting attempts
[P. 5]	**Starting Attempts [3]** Range: 1-10 This parameter sets the number of attempts in the automatic start cycle
[P.6]	**Generator UnderVoltage, short-circuit [inh.]** Range: 80-400V. If the voltage drops under the [setting] for at least 6 secs, or under [setting]-20% for 1 sec, the Under-Voltage protection [Lo U] will shut down the engine.
[P.7]	**Generator Over-Voltage [500V]** Range: 110-550V or [inh.]. If the Generator voltage rises above the [setting] for at least 2 seconds, the EP6 will energize the over voltage protection [Hi U] (see section 4.0) to stop the engine. The [inh.] code inhibits the over voltage.
[P.8]	**Generator Under-Frequency [Inh.]** [inh.] 1 to 99Hz ([inh]=disables the under frequency) This protection is delayed by about 6 seconds. The EP6 shuts down the engine and the display will show the [Lo H] message.
[P.9]	**Generator Over-Frequency [55]** 45 Hz to [inh.] ([inh.] disables the over frequency) This protection is delayed by about 2 seconds. The EP6 shuts down the engine and displays [Hi H]
[P.10]	**Current Transformer Size [...]** The range is 10/5 up to 1000/5
[P.11]	**Generator Overload Setting [inh.]** Range: [inh.] to 1000 AThe EP6 shuts down the engine after a delay of 6 secs and shows the message [E05].
[P.12]	**Generator Failure Alarm [OFF]** selection: [on] or [OFF].The code [on] enables the *Generator* failure alarm. The EP6 shows the [E04] message and the engine will shut down.
[P.13]	**Glow Plugs/Choke Control (Output #11) [5"]** Range: 1 to 99 secs.The EP6 energizes the output #11 for the programmed time.
[P.14]	**Output Control [0]** The following options are available: **[0]** None - **[1]** Choke Control - **[2]** Glow Plugs Control - **[3]** Choke Control
[P.15]	**Belt Break Control [ON]** Selection: [on] or [OFF]. The Belt Break alarm is indicated by means of the message [bELt]
[P.16]	**Stop Solenoid Timing [2"]** Range: 2-99 secs. Duration of the Stop cycle.

[P.17] **Alarm Output Timing [1']**
[inh.] 1-59 secs 1-15 mins and [cont]. Time-out of the alarm output. The code [cont] disables the time-out, and the alarm remains energized until the OFF operating mode is selected. The [inh.] mode enables the use of the external contactor

[P.18] **Temperature Switch [n.o.]**
Selection: [n.o.] or [n.c.]
[n.o.] the engine shuts down if the contact closes
[n.c.] the engine shuts down if the contact opens

[P.19] **ALARM Control [n.c.]**
Selection: [n.o.] or [n.c.]
[n.o.] the engine shuts down if the contact closes
[n.c.] the engine shuts down if the contact opens

[P.20] **Remote Start [n.o.]**
Selection: [n.o.] or [n.c.]
[n.o.] the engine starts if the contact closes
[n.c.] the engine starts if the contact opens

[P.21] **Under Speed setting [1200]**
[Inh.] or 100-4000 r.p.m. The [Inh.] code disables the Under Speed shut down.

[P.22] **Over Speed setting [1700]**
100-4000 rpm or [Inh.]. The EP6 provides one second bypass delay. The [Inh.] code (>4000 r.p.m.) disables the Over Speed shut down.

[P.23] **Number of Teeth of the Flywheel [Inh.]**
[Inh.] or 1-500 teeth.
The [Inh.] code disables the reading of the Speed (section 3.0), the Over/Under Speed alarms, and the Crank termination (see [P.24]).

[P.24] **Crank OFF [Inh.]**
Crank Termination setting: 100-800 rpm
If the speed rises above the setting, the EP6 terminates the crank cycle. One second delay avoids false termination.The code [Inh.] inhibits the crank termination

[P.25] **Low Oil Pressure Alarm By-Pass [6"]**
Range: 0-99 secs. By-Pass Delay to ignore the Oil Pressure (input #3) during the engine starting cycle. This input requires normally closed contact

[P.26] **Automatic Periodic Test Cycle [inh.]**
Range: [inh.], 1-99 days
This is the interval time between the automatic periodic tests of the engine. The code [inh.] disables the Automatic Periodic Test (see section 19.0)

[P.27] **Automatic Engine Test Duration [10']**
Range: 1-99 minutes.
This is the duration of the automatic engine test.

[P.28] **Generator warm-up timing [20"]**
Range [inh.] 1-59 secs or 1-15 mins ([inh.]=No warm-up)
Active only when [P17]= [inh.] and the ALARM output is used to drive the contactor

[P.29] **Generator cooling timing [30"]**
Range [inh.] 1-59 secs or 1-15 mins ([inh.]=No cooling)
Active only when [P28]= [inh.] and the ALARM output is used to drive the GEN-SET contactor

[P.30] **N° poles of the alternator [...]**
Range [inh.] - [2] = 2 pole alternator - [4] = 4 pole alternator

[P.31] **Engine shut-down delay for low fuel [5']**
Range [inh.] = provides only optical - acoustical warning - 1 - 99 min.

7.0 REMOTE START

The EP6 features REMOTE START only in AUTO operating mode.
To operate the REMOTE START, follow the instructions.

A) - Turn the KEY-SWITCH to the ON position; the Display and LEDs illuminate for 1 sec.
B) - Wait until the end of the LEDs test.
C) - Push the AUTO pushbutton as soon as possible (otherwise, after 20 seconds the EP6 enters the STARTING FAILURE); the [AUTO] yellow LED will illuminate as described in the section 4.

REMOTE START SWITCH:

If the REMOTE START input is activated, the [AUTO] yellow LED illuminates continuously and the display will indicate the count down of the internal ***start delay*** timer. The engine will start after the programmed ***start delay*** time. If the REMOTE START is deactivated, the EP6 drives the ***stop delay time***. The display will indicate the count down and the [AUTO] yellow LED will flash. The engine will stop after the programmed ***stop delay*** time.

8.0 SAFETY

NOTE

High voltage is present inside the EP6. To avoid electric-shock hazard, operating personnel must not remove the protective cover. Do not disconnect the grounding connection. Any interruption of the grounding connection can create an electric shock hazard. Before making external connections, always ground the PANEL first by connecting the control panel to ground.

9.0 Automatic periodic TEST

The EP6 does not use a clock to count the programmed days ([P.26] setting, section 6.0). The maximum error and drift of the counter is +/-0,5%. The user may experiment with shifting the periodic tests. To avoid error accumulation, and in case your unit is programmed to allow Automatic Periodic Test, we recommend the following procedures.
- disconnect the power supply of the EP6 *(consult your genset supplier)*
- wait for the desired start time (external clock reference)
- apply the power supply to the EP6 *(consult your genset supplier)*
- select the "AUTO" operating mode

The EP6 will start the engine after the programmed number of days and the engine will run for the programmed time. To determine how the Automatic Periodic Test is programmed enter the Reading Mode (section 6.0 parameter [P.26] and [P.27]).

IMPORTANT NOTES

If the supply (battery voltage) is removed, the EP6 loses the counts and timings. If the supply restores, the EP6 starts to count the A.P.T. according to the programmed parameters [P.26] and [P.27]. It is important to synchronize the power on sequence with the desired Automatic Periodic Test.

Problem	Possible cause	Solution
ENGINE		
The motor does not start up	1) Start-up switch (I6) (where it is assembled) in incorrect position	1) Check position
	2) Emergency button (L5) pressed	2) Unblock
	3) Preheating (where it is assembled)	3) Lacking or insufficient preheating phase for sparkplugs. Malfunction in circuit: repair.
	4) Engine control unit or starting key faulty.	4) Replace
	5) Battery low	5) Recharge or replace. Check the battery charge circuit on motor and automatic panel.
	6) Battery cable terminals loose or corroded	6) Tighten and clean. Replace if corroded.
	7) Start-up motor defective	7) Repair or replace.
	8) No fuel or air in feed circuit	8) Refill tank, un-aerate the circuit.
	9) Malfunction on feed circuit: defective pump, injector blocked, etc.	9) Ask for intervention of Service Department.
	10) Air filter or fuel filter clogged	10) Clean or replace
	11) Air in the gasoil filter.	11) Take the air out filling the filter with gasoil.
	12) Motor stopping device defective	12) Replace.
	13) Malfunction on electrical power circuit on generator control panel	13) Check and repair.
The motor does not accelerate. Inconstant speed.	1) Air filter or fuel filter clogged.	1) Clean or replace.
	2) Malfunction on feed circuit: defective pump, injector blocked, etc.	2) Ask for intervention of Service Department.
	3) Oil level too high.	3) Eliminate excess oil.
	4) Motor speed regulator defective.	4) Ask for intervention of Service Department
Black smoke	1) Air filter clogged.	1) Clean or replace
	2) Overload.	2) Check the load connected and diminish.
	3) Injectors defective. Injection pump requires calibration.	3) Ask for intervention of Service Department.
White smoke	1) Oil level too high.	1) Eliminate excess oil.
	2) Motor cold or in prolonged operation with little or no load.	2) Insert load only with motor sufficiently hot
	3) Segments and/or cylinders worn out.	3) Ask for intervention of Service Department.
Too little power provided by motor.	1) Air filter clogged.	1) Clean or replace.
	2) Insufficient fuel distribution, impurities or water in feed circuit.	2) Check the feed circuit, clean and refill once again.
	3) Injectors dirty or defective.	3) Ask for intervention of Service Department.
Low oil pressure	1) Oil level insufficient	1) Reset level. Check for leaks.
	2) Air filter clogged.	2) Replace filter.
	3) Oil pump defective.	3) Ask for intervention of Service Department.
	4) Alarm malfunction.	4) Check the sensor and electrical circuit.
High temperature	1) Overload	1) Check the load connected and diminish.
	2) Insufficient ventilation.	2) Check the cooling vent and relative transmission belts
	3) Insufficient coolant liquid (Only for water cooled motors)	3) Restore level. Check for leaks or breakage in the entire cooling circuit, pipes, couplings, etc.
	4) Water radiator or oil clogged (where it is assembled)	4) Clean cooling fins on radiator
	5) Water circulating pump defective (Only for water cooled motors)	5) Ask for intervention of Service Department
	6) Injectors defective. Injection pump requires calibration	6) Ask for intervention of Service Department
	7) Alarm malfunction	7) Check the sensor and electrical circuit

Problem	Possible cause	Solution
GENERATOR		
Absence of output voltage	1) Voltage switch in position 0 2) Voltage switch faulty 3) Protection tripped due to overload 4) Differential protection device tripped. (Differential switch, differential relay) 5) Protection devices defective 6) Alternator not sparked 7) Alternator defective	1) Check position 2) Check connections and working of the switch, repair or replace 3) Check the load connected and diminish 4) Check on the entire installation: cables, connections, utilities connected have no defective sheathing which may cause incorrect currents to ground 5) Replace 6) Carry out external spark test as indicated in alternator manual. Ask for intervention of Service Department 7) Check winding, diodes, etc. on alternator (Refer to alternator manual) Repair or replace. Ask for intervention of Service Department
No-load voltage too low or too high	1) Incorrect motor running speed 2) Voltage regulating device (where it is assembled) defective or requires calibration 3) Alternator defective	1) Regulate speed to its nominal no-load value 2) Adjust regulator device as indicated in alternator manual, or replace. For generators with double voltage control AVR and COMPOUND, act on the excitation circuit as shown in the alternator manual. 3) Check winding, diodes, etc. on alternator (Refer to alternator manual) Repair or replace Ask for intervention of Service Department
Corrected no-load voltage too low with load	1) Incorrect motor running speed due to overload 2) Load with cos φ less than 0.8 3) Alternator defective	1) Check the load connected and diminish 2) Reduce or rephase load 3) Check winding, diodes, etc. on alternator (Refer to alternator manual) Repair or replace Ask for intervention of Service Department
Unstable tension	1) Contacts malfunctioning 2) Irregular rotation of motor 3) Alternator defective	1) Check electrical connections and tighten 2) Ask for intervention of Service Department 3) Check winding, diodes, etc. on alternator (Refer to alternator manual) Repair or replace Ask for intervention of Service Department

⚠ WARNING

MOVING PARTS can injure

- Have **qualified** personnel do maintenance and troubleshooting work.
- Stop the engine before doing any work inside the machine. If for any reason the machine must be operated while working inside, **pay attention** moving parts, hot parts (exhaust manifold and muffler, etc.) electrical parts which may be unprotected when the machine is open.
- Remove guards only when necessary to perform maintenance, and replace them when the maintenance requiring their removal is complete.
- Use suitable tools and clothes.
- Do not modify the components if not authorized.

- See pag. M1.1 -

HOT surface can hurt you

NOTE

By maintenance at care of the utilizer we intend all the operatios concerning the verification of mechanical parts, electrical parts and of the fluids subject to use or consumption during the normal operation of the machine.

For what concerns the fluids we must consider as maintenance even the periodical change and or the refills eventually necessary.

Maintenance operations also include machine cleaning operations when carried out on a periodic basis outside of the normal work cycle.

The repairs **cannot be considered** among the maintenance activities, i.e. the replacement of parts subject to occasional damages and the replacement of electric and mechanic components consumed in normal use, by the Assistance Authorized Center as well as by manufacturer.

The replacement of tires (for machines equipped with trolleys) must be considered as repair since it is not delivered as standard equipment any lifting system.

The periodic maintenance should be performed according to the schedule shown in the engine manual. An optional hour counter (M) is available to simplify the determination of the working hours.

⚠ IMPORTANT

In the maintenance operations avoid that polluting substances, liquids, exhausted oils, etc. bring damage to people or things or can cause negative effects to surroindings, health or safety respecting completely the laws and/or dispositions in force in the place.

ENGINE and ALTERNATOR

PLEASE REFER TO THE SPECIFIC MANUALS PROVIDED.

Every engine and alternator manufacturer has maintenance intervals and specific checks for each model: it is necessary to consult the specific engine or alternator USER AND MAINTENANCE manual.

VENTILATION

Make certain there are no obstructions (rags, leaves or other) in the air inlet and outlet openings on the machine, alternator and motor.

ELECTRICAL PANELS

Check condition of cables and connections daily.
Clean periodically using a vacuum cleaner, **DO NOT USE COMPRESSED AIR.**

DECALS AND LABELS

*All warning and decals should be checked once a year and **replaced** if missing or unreadable.*

STRENUOUS OPERATING CONDITIONS

Under extreme operating conditions (frequent stops and starts, dusty environment, cold weather,extended periods of no load operation, fuel with over 0.5% sulphur content) do maintenance more frequently.

BATTERY WITHOUT MAINTENANCE
DO NOT OPEN THE BATTERY

The battery is charged automatically from the battery charger circuit suppplied with the engine.

Check the state of the battery from the colour of the warning light which is in the upper part.

- Green colour: battery OK
- Black colour: battery to be recharged
- White colour: battery to be replaced

⚠ NOTE

THE ENGINE PROTECTION NOT WORK WHEN THE OIL IS OF LOW QUALITY BECAUSE NOT CHARGED REGULARLY AT INTERVALS AS PRESCRIBED IN THE OWNER'S ENGINE MANUAL.

ATTENTION

- Maintenance operations on the electricity-generating group prearranged for automatic operation must be carried out with the panel in RESET mode.
- Maintenance operations on the installation's electrical panels must be carried out in complete safety by cutting off all external power sources: ELECTRICAL POWER, GROUP and BATTERY.

For the electricity-generating groups prearranged for automatic operation, in addition to carrying out all periodic maintenance operations foreseen for normal usage, various operations must be carried out that are necessary in relation to the specific type of use. The electricity-generating group in fact must be continuously prepared for operation, even after prolonged periods of inactivity.

MAINTENANCE GENERATING SET WITH AUTOMATIC BOARD

	EVERY WEEK	EVERY MONTH AND/OR AFTER INTERVENTION ON LOAD	EVERY YEAR
1. TEST or AUTOMATIC TEST cycle to keep the generating set constantly operative	NO-LOAD X	WITH LOAD X	
2. Check all levels: engine oil, fuel level, battery electrolyte,, if necessary top it up.	X	X	
3. Control of electrical connections and cleaning of control panel		X	X

● **Carry out motor oil change at least once a year, even if the requested number of hours has not been attained.**

In case the machine should not be used for more than 30 days, make sure that the room in which it is stored presents a suitable shelter from heat sources, weather changes or anything which can cause rust, corrosion or damages to the machine.

☞ Have **qualified** personnel prepare the machine for storage.

GASOLINE ENGINE

Start the engine: It will run until it stops due to the lack of fuel.

Drain the oil from the engine sump and fill it with new oil (see page M25).

Pour about 10 cc of oil into the spark plug hole and screw the spark plug, after having rotated the crankshaft several times.

Rotate the crankshaft slowly until you feel a certain compression, then leave it.

In case the battery, for the electric start, is assembled, disconnect it.

Clean the covers and all the other parts of the machine carefully.

Protect the machine with a plastic hood and store it in o dry place.

DIESEL ENGINE

For short periods of time it is advisable, about every 10 days, to make the machine work with load for 15-30 minutes, for a correct distribution of the lubricant, to recharge the battery and to prevent any possible bloking of the injection system.

For long periods of inactivity, turn to the after soles service of the engine manufacturer.

Clean the covers and all the other parts of the machine carefully.

Protect the machine with a plastic hood and store it in a dry place.

In case of necessity for first aid and of fire prevention, see page. M2.5.

IMPORTANT

In the storage operations avoid that polluting substances, liquids, exhausted oils, etc. bring damage to people or things or can cause negative effects to surroindings, health or safety respecting completely the laws and/or dispositions in force in the place.

☞ Have **qualified** personnel disassemble the machine and dispose of the parts, including the oil, fuel, etc., in a correct manner when it is to be taken out of service.

As cust off we intend all operations to be made, at utilizer's care, at the end of the use of the machine. This comprises the dismantling of the machine, the subdivision of the several components for a further reutilization or for getting rid of them, the eventual packing and transportation of the eliminated parts up to their delivery to the store, or to the bureau encharged to the cust off or to the storage office, etc.

The several operations concerning the cust off, involve the manipulation of fluids potentially dangerous such as: lubricating oil and battery electrolyte.

The dismantling of metallic parts liable to cause injuries or wounds, must be made wearing heavy gloves and using suitable tools.

The getting rid of the various components of the machine must be made accordingly to rules in force of law a/o local rules.
Particular attention must be paid when getting rid of:
lubricating oils, battery electrolyte, and inflammable liquids such as fuel, cooling liquid.

The machine user is responsible for the observance of the norms concerning the environment conditions with regard to the elimination of the machine being cust off and of all its components.

In case the machine should be cust off without any previous disassembly it is however compulsory to remove:
- tank fuel
- engine lubricating oil
- cooling liquid from the engine
- battery

NOTE: BCS is involved with custing off the machine **only** for the second hand ones, when not reparable. This, of course, after authorization.

In case of necessity for first aid and fire prevention, see page M2.5.

IMPORTANT

In the cust-off operations avoid that polluting substances, liquids, exhausted oils, etc. bring damage to people or things or can cause negative effects to surroindings, health or safety respecting completely the laws and/or dispositions in force in the place.

ELECTRICAL SYSTEM LEGENDE

A : Alternator
B : Wire connection unit
C : Capacitor
D : G.F.I.
E : Welding PCB transformer
F : Fuse
G : 400V 3-phase socket
H : 230V 1phase socket
I : 110V 1-phase socket
L : Socket warning light
M : Hour-counter
N : Voltmeter
P : Welding arc regulator
Q : 230V 3-phase socket
R : Welding control PCB
S : Welding current ammeter
T : Welding current regulator
U : Current transformer
V : Welding voltage voltmeter
Z : Welding sockets
X : Shunt
W : D.C. inductor
Y : Welding diode bridge
A1 : Arc striking resistor
B1 : Arc striking circuit
C1 : 110V D.C./48V D.C. diode bridge
D1 : E.P.1 engine protection
E1 : Engine stop solenoid
F1 : Acceleration solenoid
G1 : Fuel level transmitter
H1 : Oil or water thermostat
I1 : 48V D.C. socket
L1 : Oil pressure switch
M1 : Fuel warning light
N1 : Battery charge warning light
O1 : Oil pressure warning light
P1 : Fuse
Q1 : Starter key
R1 : Starter motor
S1 : Battery
T1 : Battery charge alternator
U1 : Battery charge voltage regulator
V1 : Solenoid valve control PCBT
Z1 : Solenoid valve
W1 : Remote control switch
X1 : Remote control and/or wire feeder socket
Y1 : Remote control plug
A2 : Remote control welding regulator
B2 : E.P.2 engine protection
C2 : Fuel level gauge
D2 : Ammeter
E2 : Frequency meter
F2 : Battery charge trasformer
G2 : Battery charge PCB
H2 : Voltage selector switch
I2 : 48V a.c. socket
L2 : Thermal relay
M2 : Contactor
N2 : G.F.I. and circuit breaker
O2 : 42V EEC socket
P2 : G.F.I. resistor
Q2 : T.E.P. engine protection
R2 : Solenoid control PCBT
S2 : Oil level transmitter
T2 : Engine stop push-button T.C.1
U2 : Engine start push-buttonT.C.1
V2 : 24V c.a. socket
Z2 : Thermal magnetic circuit breaker
W2 : S.C.R. protection unit
X2 : Remote control socket
Y2 : Remote control plug
A3 : Insulation moitoring
B3 : E.A.S. connector
C3 : E.A.S. PCB
D3 : Booster socket
E3 : Open circuit voltage switch
F3 : Stop push-button
G3 : Ignition coil
H3 : Spark plug
I3 : Range switch
L3 : Oil shut-down button
M3 : Battery charge diode
N3 : Relay
O3 : Resistor
P3 : Sparkler reactor
Q3 : Output power unit
R3 : Electric siren
S3 : E.P.4 engine protection
T3 : Engine control PCB
U3 : R.P.M. electronic regulator
V3 : PTO HI control PCB
Z3 : PTO HI 20 l/min push-button
W3 : PTO HI 30 l/min push-button
X3 : PTO HI reset push-button
Y3 : PTO HI 20 l/min indicator
A4 : PTO HI 30 l/min indicator
B4 : PTO HI reset indicator
C4 : PTO HI 20 l/min solenoid valve
D4 : PTO HI 30 l/ min solenoid valve
E4 : Hydraulic oil pressure switch
F4 : Hycraulic oil level gauge
G4 : Preheating glow plugs
H4 : Preheating gearbox
I4 : Preheating indicator
L4 : R.C. filter
M4 : Heater with thermostat
N4 : Choke solenoid
O4 : Step relay
P4 : Circuit breaker
Q4 : Battery charge sockets
R4 : Sensor, cooling liquid temperature
S4 : Sensor, air filter clogging
T4 : Warning light, air filter clogging
U4 : Polarity inverter remote control
V4 : Polarity inverter switch
Z4 : Transformer 230/48V
W4 : Diode bridge, polarity change
X4 : Base current diode bridge
Y4 : PCB control unit, polarity inverter
A5 : Base current switch
B5 : Auxiliary push-button ON/OFF
C5 : Accelerator electronic control
D5 : Actuator
E5 : Pick-up
F5 : Warning light, high temperature
G5 : Commutator auxiliary power
H5 : 24V diode bridge
I5 : Y/▲ commutator
L5 : Emergency stop button
M5 : Engine protection EP5
N5 : Pre-heat push-button
O5 : Accelerator solenoid PCB
P5 : Oil pressure switch
Q5 : Water temperature switch
R5 : Water heater
S5 : Engine connector 24 poles
T5 : Electronic GFI relais
U5 : Release coil, circuit breaker
V5 : Oil pressure indicator
Z5 : Water temperature indicator
W5 : Battery voltmeter
X5 : Contactor, polarity change
Y5 : Commutator/switch, series/parallel
A6 : Commutator/switch
B6 : Key switch, on/off
C6 : QEA control unit
D6 : Connector, PAC
E6 : Frequency rpm regulator
F6 : Arc-Force selector
G6 : Device starting motor
H6 : Fuel electro pump 12V c.c.
I6 : Start Local/Remote selector
L6 : Choke button
M6 : Switch CC/CV
N6 : Connector – wire feeder
O6 : 420V/110V 3-phase transformer
P6 : Switch IDLE/RUN
Q6 : Hz/V/A analogic instrument
R6 : EMC filter
S6 : Wire feeder supply switch
T6 : Wire feeder socket
U6 : DSP chopper PCB
V6 : Power chopper supply PCB
Z6 : Switch and leds PCB
W6 : Hall sensor
X6 : Water heather indicator
Y6 : Battery charge indicator
A7 : Transfer pump selector AUT-0-MAN
B7 : Fuel transfer pump
C7 : "GECO" generating set test
D7 : Flooting with level switches
E7 : Voltmeter regulator
F7 : WELD/AUX switch
G7 : Reactor, 3-phase
H7 : Switch disconnector
I7 : Solenoid stop timer
L7 : "VODIA" connector
M7 : "F" EDC4 connector
N7 : OFF-ON-DIAGN. selector
O7 : DIAGNOSTIC push-button
P7 : DIAGNOSTIC indicator
Q7 : Welding selector mode
R7 : VRD load
S7 : 230V 1-phase plug
T7 : V/Hz analogic instrument
U7 : Engine protection EP6
V7 : G.F.I. relay supply switch
Z7 : Radio remote control receiver
W7 : Radio remote control trasnsmitter
X7 : Isometer test push-button
Y7 : Remote start socket
A8 : Transfer fuel pump control
B8 : Ammeter selector switch
C8 : 400V/230V/115V commutator
D8 : 50/60 Hz switch
E8 : Cold start advance with temp. switch
F8 : START/STOP switch
G8 : Polarity inverter two way switch
H8 : Engine protection EP7
I8 : AUTOIDLE switch
L8 : AUTOIDLE PCB
M8 : A4E2 ECM engine PCB
N8 : Remote emergency stop connector
O8 : V/A digital instruments and led VRD PCB
P8 : Water in fuel
Q8 : Battery disconnect switch
R8 : Inverter
S8 : Overload led
T8 : Main IT/TN selector
U8 : NATO socket 12V
V8 : Diesel pressure switch
Z8 : Remote control PCB
W8 : Pressure turbo protection
X8 : Water in fuel sender
Y8 : EDC7-UC31 engine PCB
A9 : Low water level sender
B9 : Interface card
C9 : Limit switch
D9 : Starter timing card
E9 : Luquid pouring level float
F9 : Under voltage coil
G9 : Low water level warning light
H9 : Chopper driver PCB
I9 :
L9 :

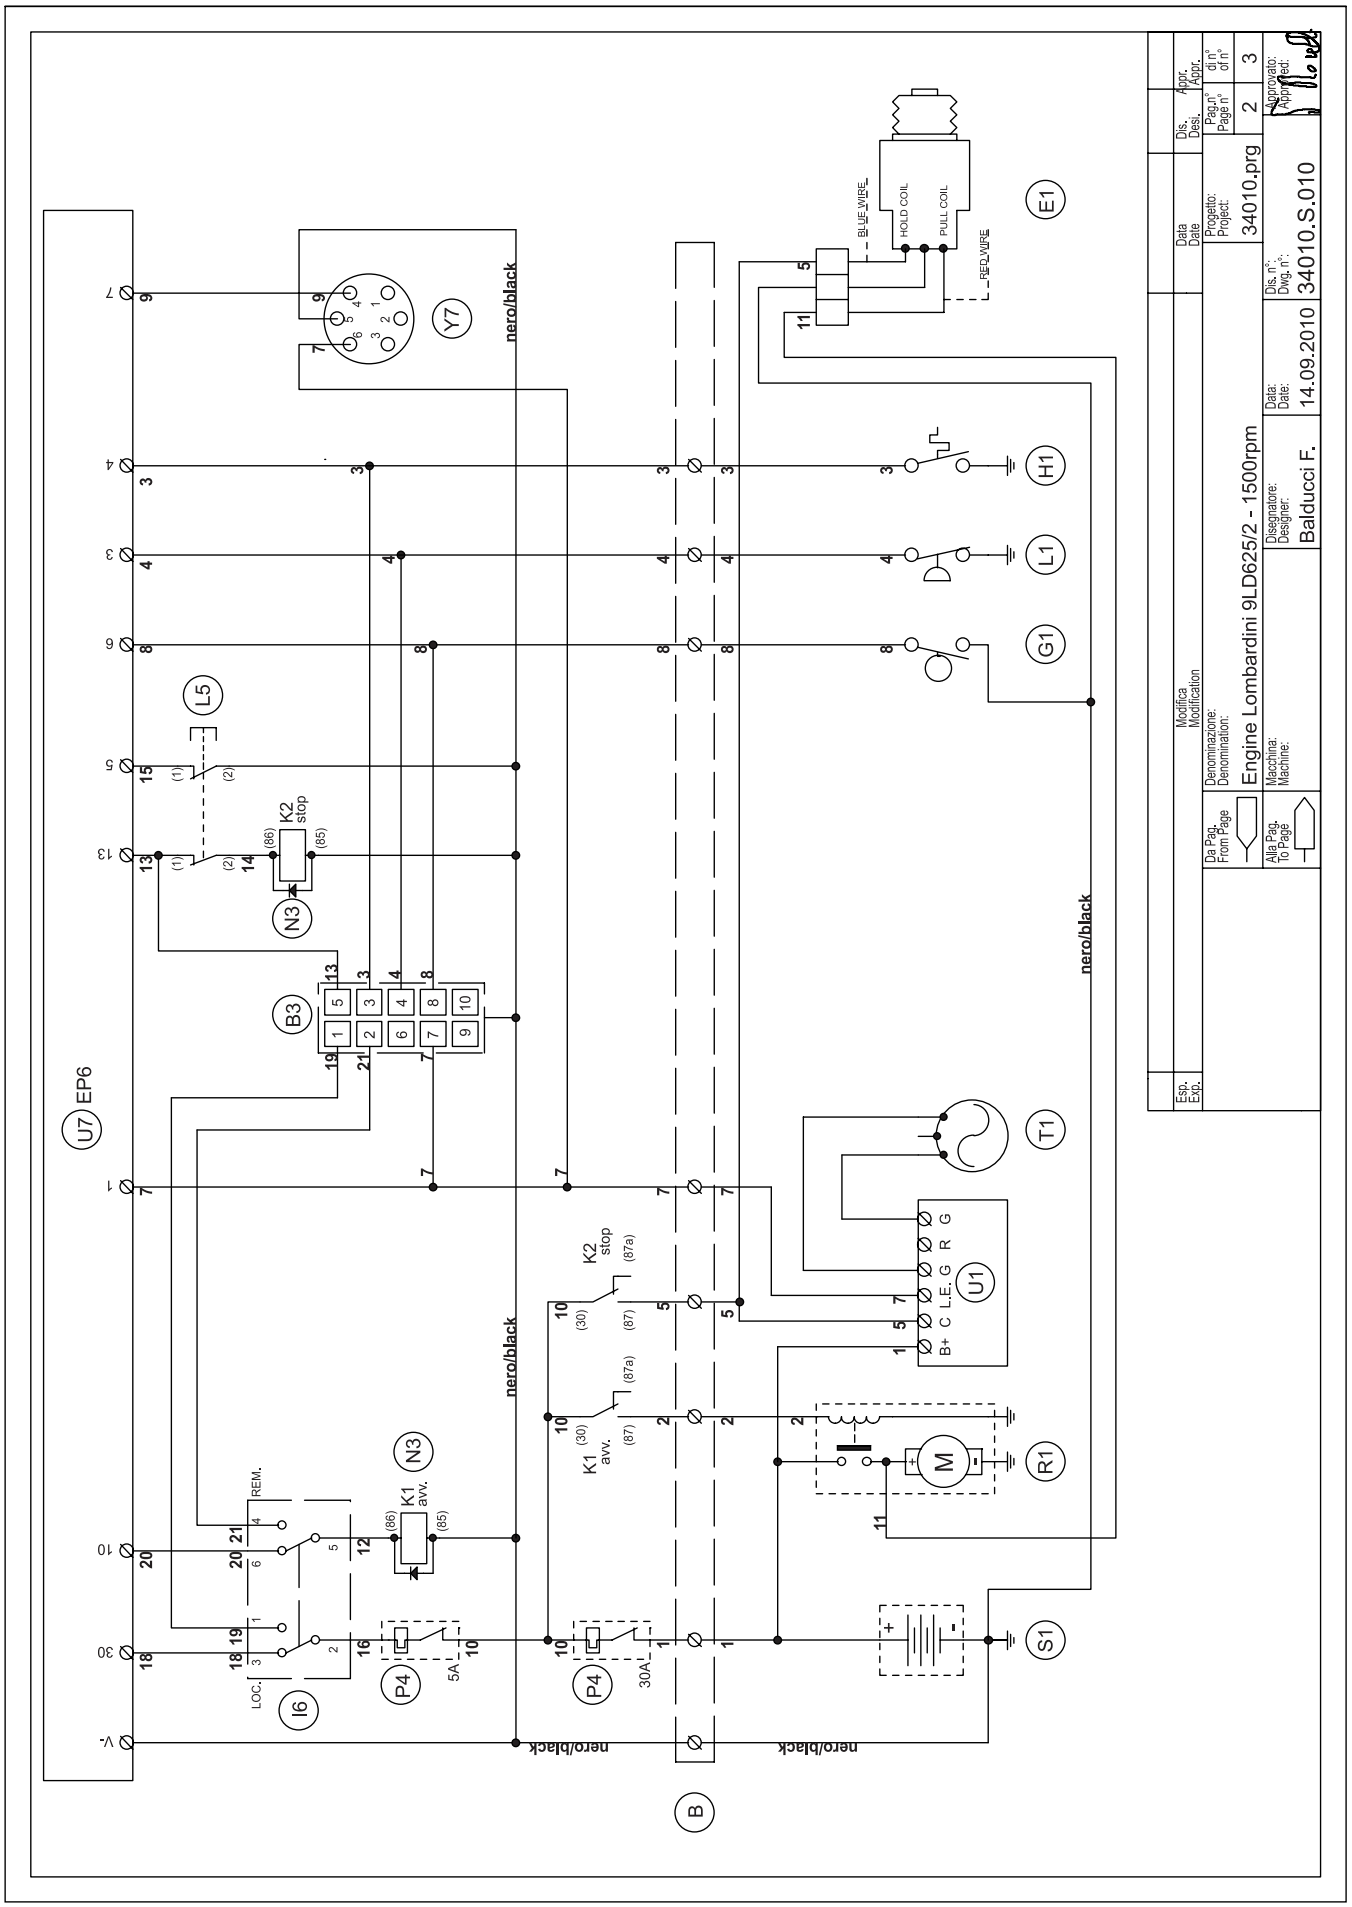
Engine Lombardini 9LD625/2 - 1500rpm
34010.prg
34010.S.010
14.09.2010
Balducci F.
BLUE WIRE
RED WIRE
HOLD COIL
PULL COIL
nero/black
K1 avv.
K2 stop
REM.
LOC.
5A
30A
B+ C L E G R G

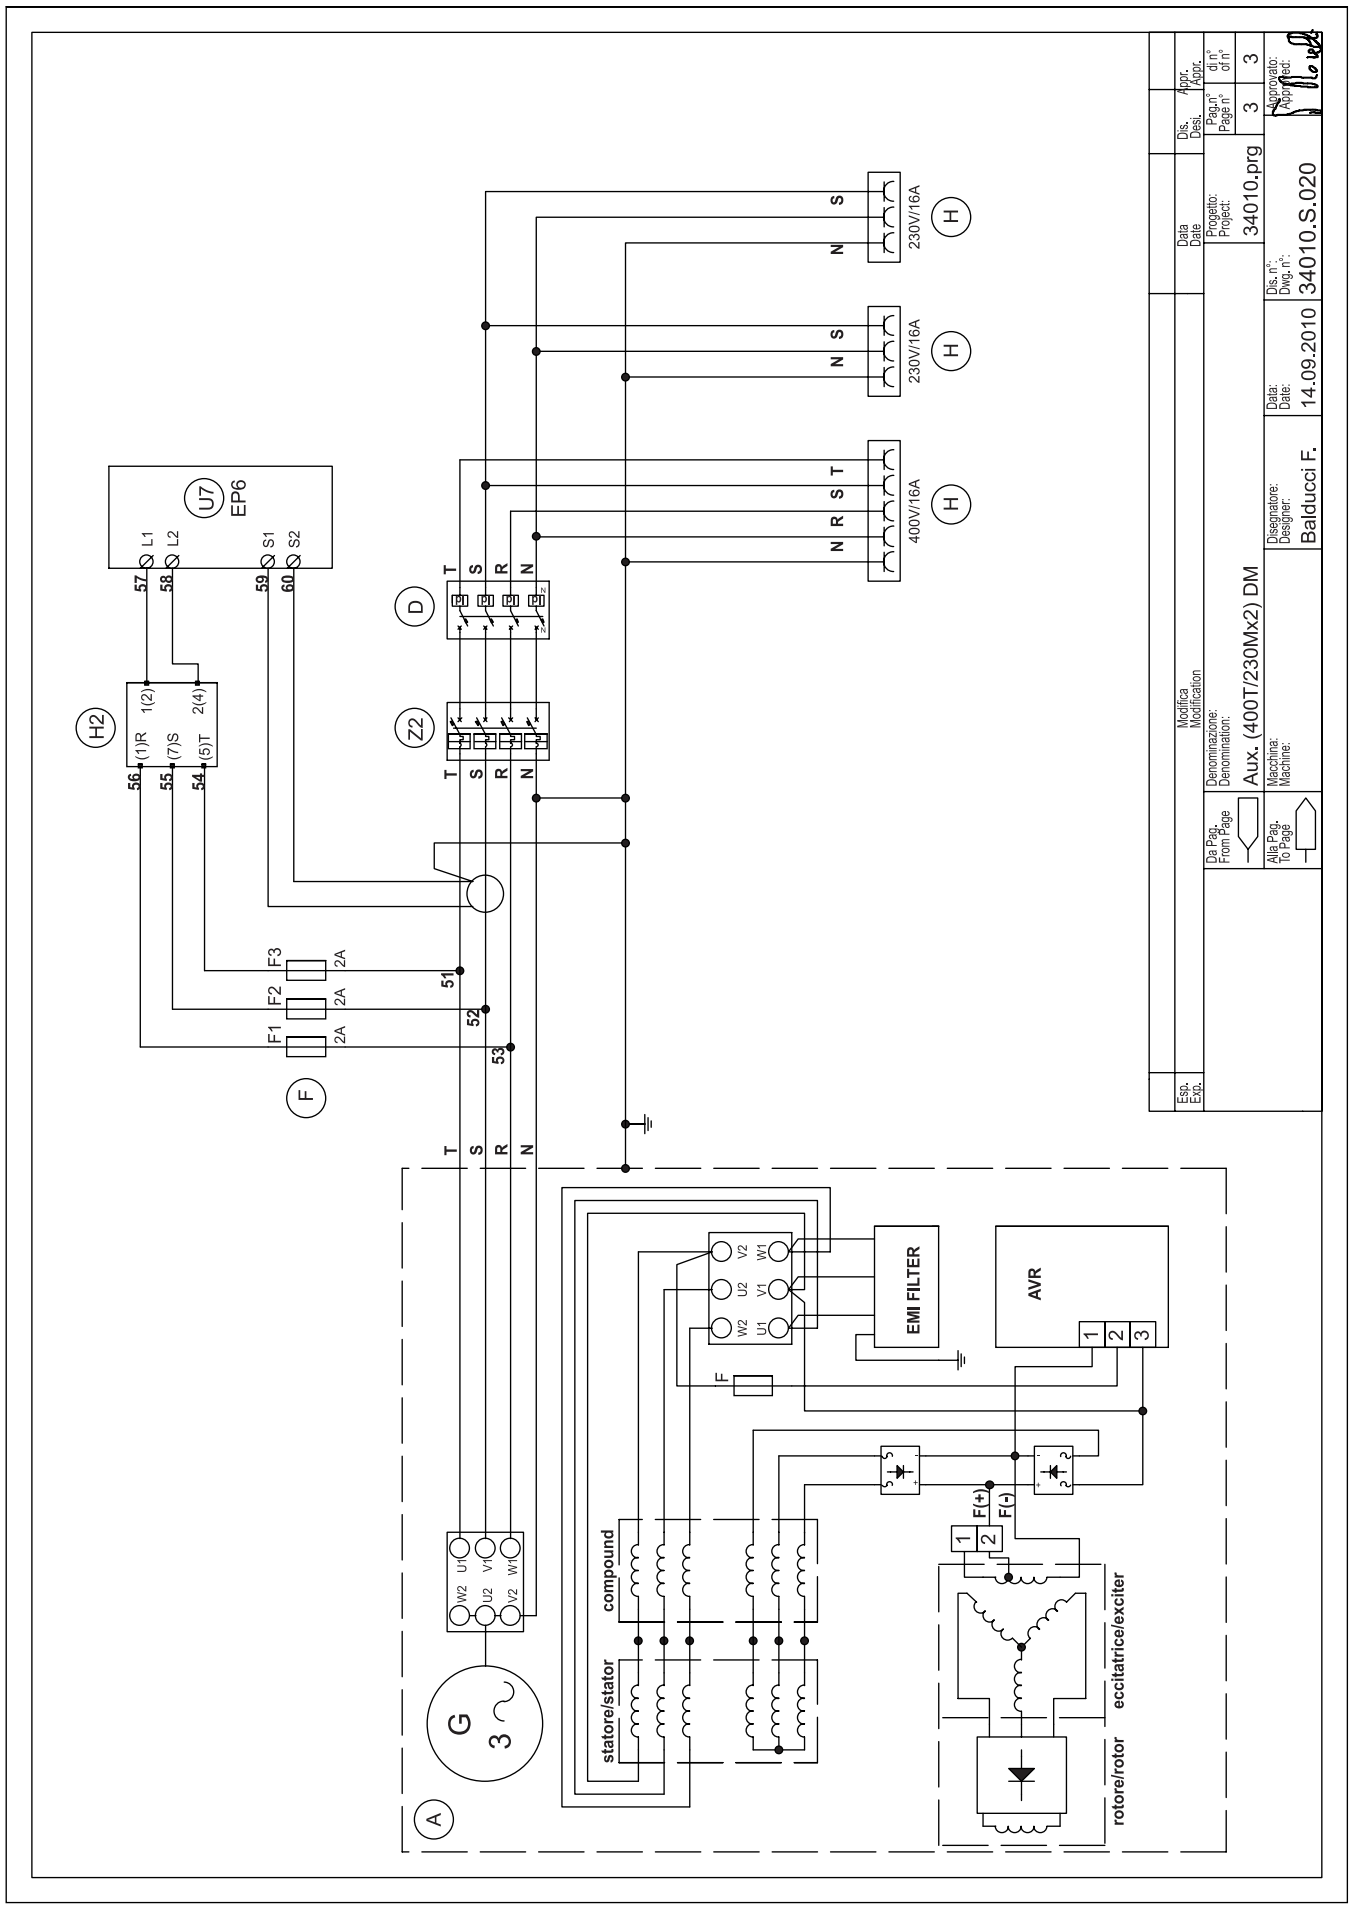
Aux. (400T/230Mx2) DM
Balducci F.
14.09.2010
34010.S.020
34010.prg
230V/16A
400V/16A
EP6
EMI FILTER
AVR
compound
statore/stator
rotore/rotor
eccitatrice/exciter
12/10/10 34010-I

The manufacturer guarantees that any request for spare parts will be satisfied.

To keep the machine in full working order, when replacement spare parts is required, always ask for genuine parts only.

☞ The requested data are to be found on the data plate located on the machine structure, quite visible and easy to consult. ✹

When ordering the spare parts, it is recommended to indicate:

1) ✹ serial number
2) ✹ model of welder and/or generating set
3) ◆ n. table
4) ◆ n. position
5) quantity

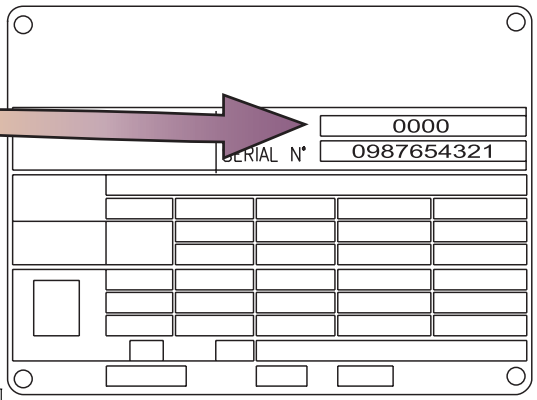

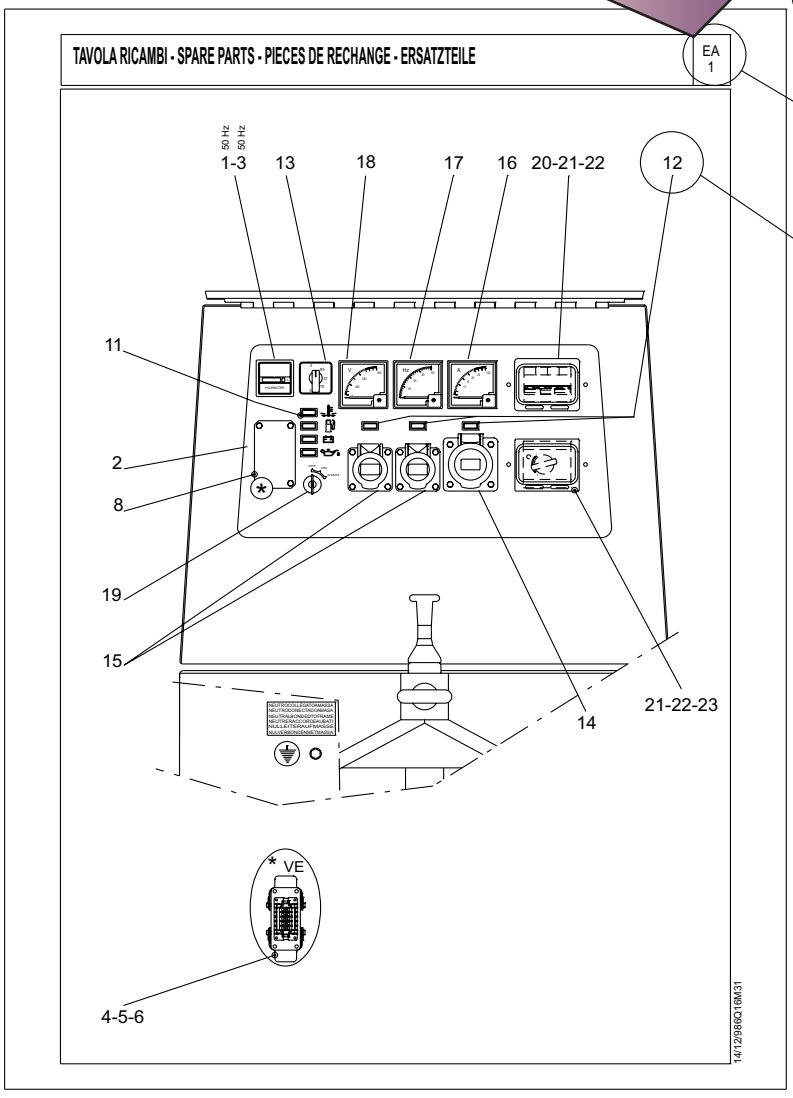

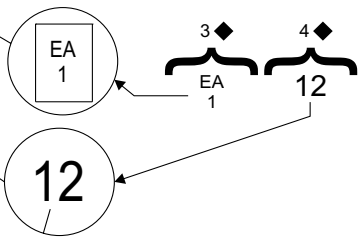

ABBREVIATIONS AND SYMBOLS:

(EV) When ordering, specify the engine type and the auxiliary voltage
(ER) Engine with recoil starter only
(ES) Engine with electric starter only
(VE) E.A.S version only.
(QM) When ordering, specify the length in meters
(VS) Special version only
(SR) By request only

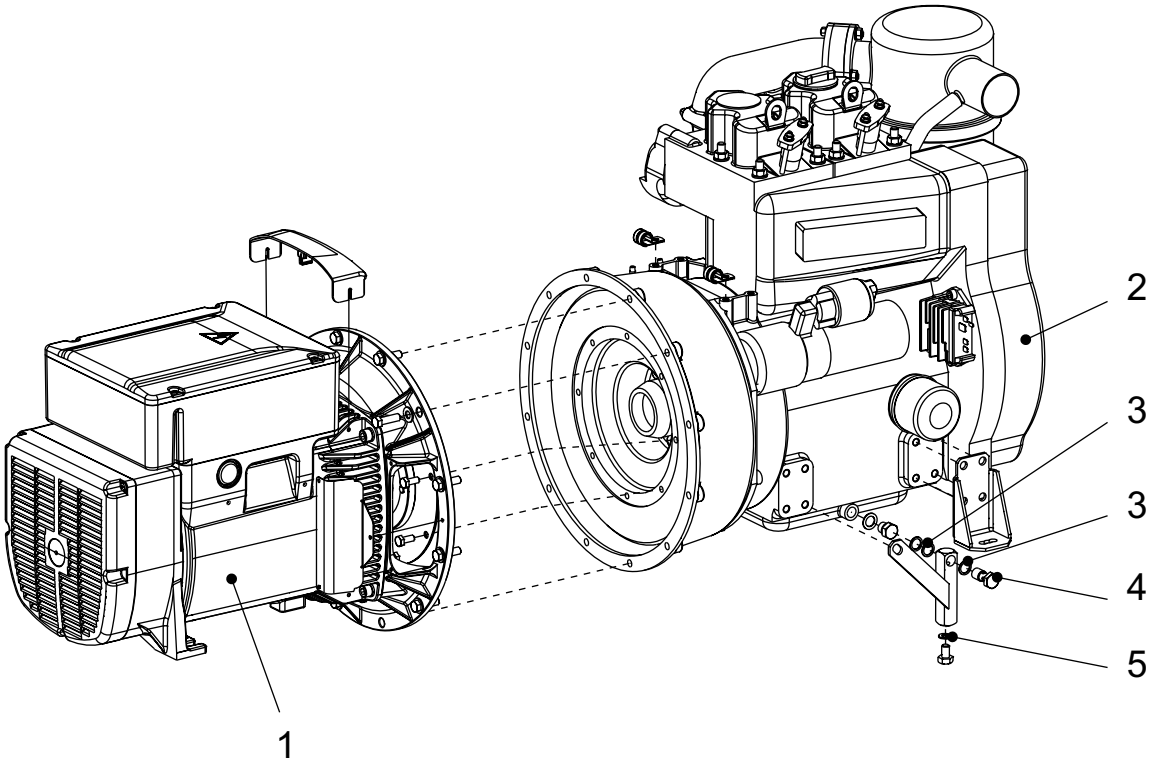
2
3
3
4
5
1

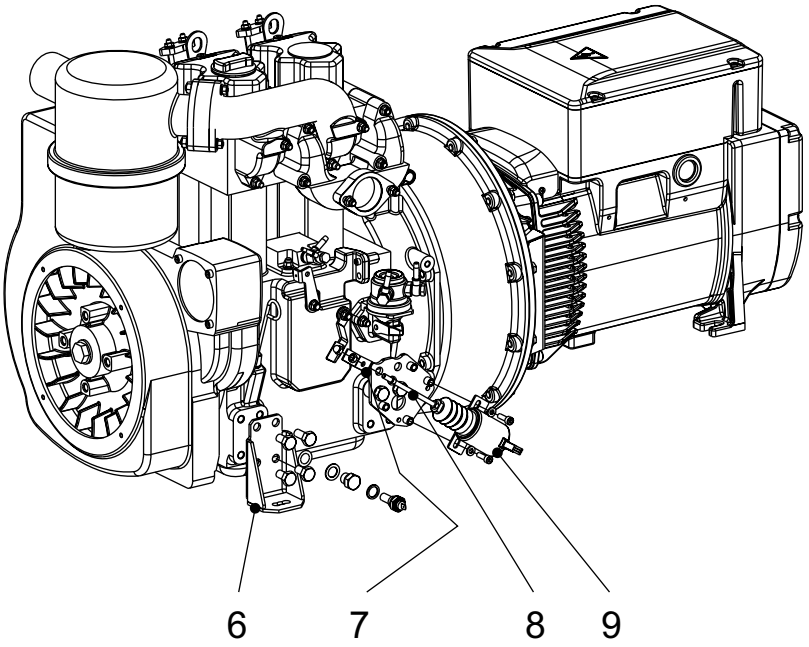
6
7
8
9

Pos.	Cod.	Descr.	Note
1	M340103100	ALTERNATORE SINCRONO TRIFASE	
2	M215102200	MOTORE LOMBARDINI 9LD625.2(620764) SAE 4-7 1/2	
3	M102043880	GUARNIZIONE	
4	M207402225	VITE	
5	M207602215	PROLUNGA SCARICO OLIO	
6	M207402224	STAFFA	
7	M217609118	SQUADRETTA	
8	M317609058	TIRANTE COMANDO ELETTROMAGNETE	
9	M274009055	SOLENOIDE	

Pos.	Cod.	Descr.	Note
1	M340103100	ALTERNATOR	
2	M215102200	LOMBARDINI ENGINE	
3	M102043880	GASKET	
4	M207402225	SCREW	
5	M207602215	EXTENSION, OIL DRAIN	
6	M207402224	BRACKET FOR ENGINE SUPPORT	
7	M217609118	SQUARE	
8	M317609058	TIE-ROD	
9	M274009055	SOLENOID	

(I) Tavola ricambi (GB) Spare parts table (F) Table piéces de rechange	(D) Ersatzteile (E) Tabla de recambios (NL)	GE 10 LSX	HK 16 REV.0-10/10

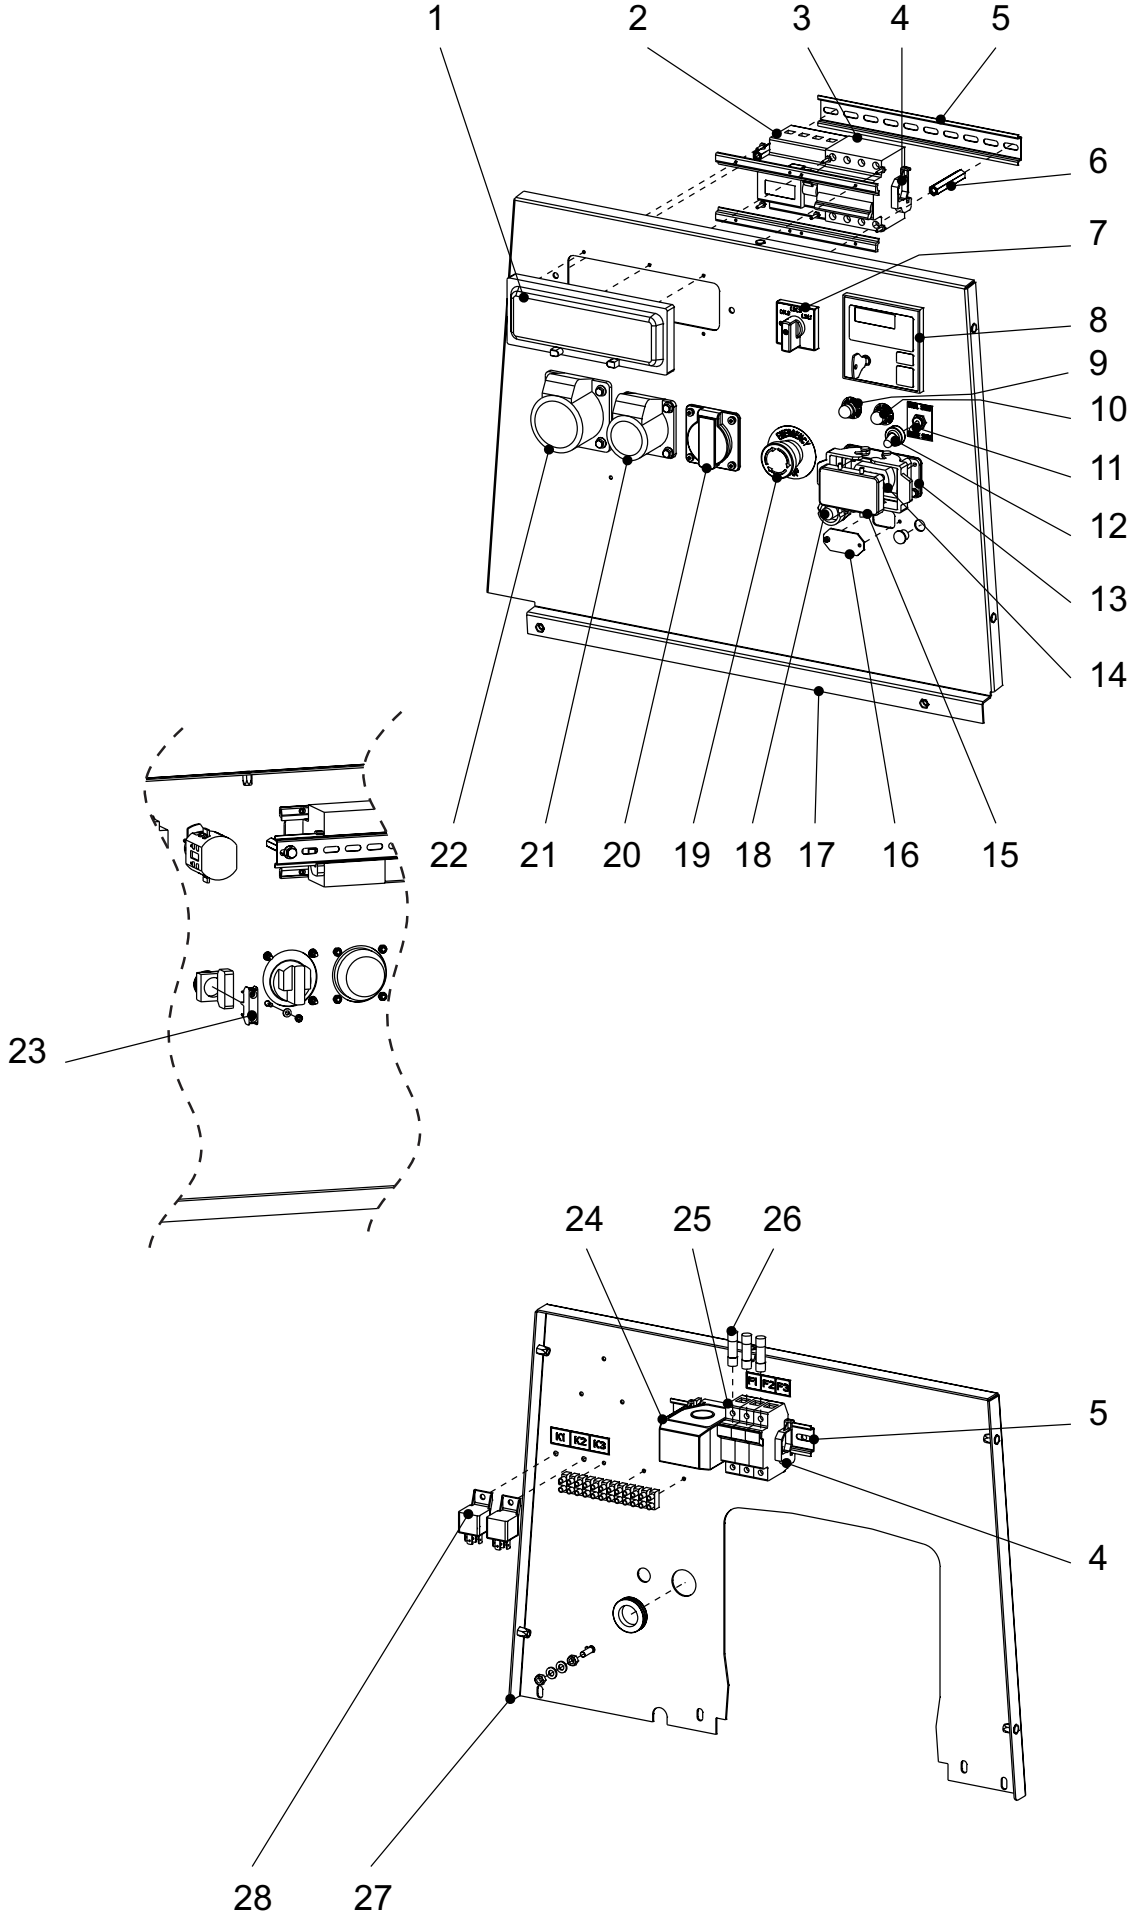

12/10/10 34010-I

Pos.	Cod.	Descr.	Note
1	M317807130	COPERCHIO PROTEZIONE I.D.	
2	M105111540	Vedi Cod.219937105	
3	M215109705	INTERRUTTORE MAGNETOTERMICO	
4	M1241010	PIASTRINA	
5	M1243020	GUIDA PER MORSETTIERA	
6	M201308039	COLONNETTA	
7	M305717315	COMMUTATORE	
8	MJK0029770	UNITA'CONTR. MOTORE (EP6)	
9	M873407107	DISGIUNTORE TERMICO 30A/250V	
10	M352007109	PROTEZIONE TERMICA 5A	
11	M102013290	COMMUTATORE	
12	M102042740	CAPPUCCIO	
13	M105191550	CUSTODIA PER PRESA EAS	
14	M105191560	FRUTTO PRESA CONNETTORE	
15	M105191570	COPERCHIO PER PRESA EAS	
16	M359257032	COPERCH. CHIUS.FORO SCALDIGLIA	
17	M340107020	PANNELLO FRONTALE	
18	M34010C021	GRUPPO CAVI MOTORE (FRONTALE)	
19	M744507219	PULSANTE STOP D'EMERGENZA	
20	M259107241	PRESA SCHUKO 16A 230V - 2P+T	
21	M307017240	PRESA 220V 16A	
22	M305907270	PRESA CEE 16A 400V 3P+N+T	
23	M744507237	CONTATTO	
24	M343337306	TRASFORMATORE	
25	M107509045	PORTAFUSIBILE	
26	M1291190	FUSIBILE	
27	M250208217	PARATIA SUP. ALTERNATORE	
28	M306479199	RELE' AVV. ELETTRICO	

Pos.	Cod.	Descr.	Note
1	M317807130	COVER PROTECTION	
2	M105111540	See part no. 219937105	
3	M215109705	MAGNETOTHERMIC INTERRUPTOR	
4	M1241010	SMALL PLATE	
5	M1243020	TERMINAL GUIDE	
6	M201308039	CONNECTING CYLINDER	
7	M305717315	COMMUTATOR	
8	MJK0029770	ENGINE CONTROL UNIT EP6	
9	M873407107	CIRCUIT BREAKER 30A/250V	
10	M352007109	THERMOPROTECTION	
11	M102013290	COMMUTATOR	
12	M102042740	CAP	
13	M105191550	BOX, EAS SOCKET	
14	M105191560	SOCKET, EAS	
15	M105191570	BLIND PLATE, EAS SOCKET	
16	M359257032	COVER	
17	M340107020	FRONT PANEL	
18	M34010C021	STARTING KEY CABLING	
19	M744507219	EMERGENCY PUSH BUTTON STOP	
20	M259107241	SOCKET SCHUKO 16A 230V 2P+T	
21	M307017240	EEC SOCKET 16A, 220V 2P+T	
22	M305907270	EEC SOCKET 16A 400V 3P+N+T	
23	M744507237	CONTACT N.C.	
24	M343337306	TRANSFORMER 60/5A	
25	M107509045	HOLDER, FUSE	
26	M1291190	FUSE	
27	M250208217	ALTERNATOR TOP BULKHEAD	
28	M306479199	RELAY, ELECTRIC START	

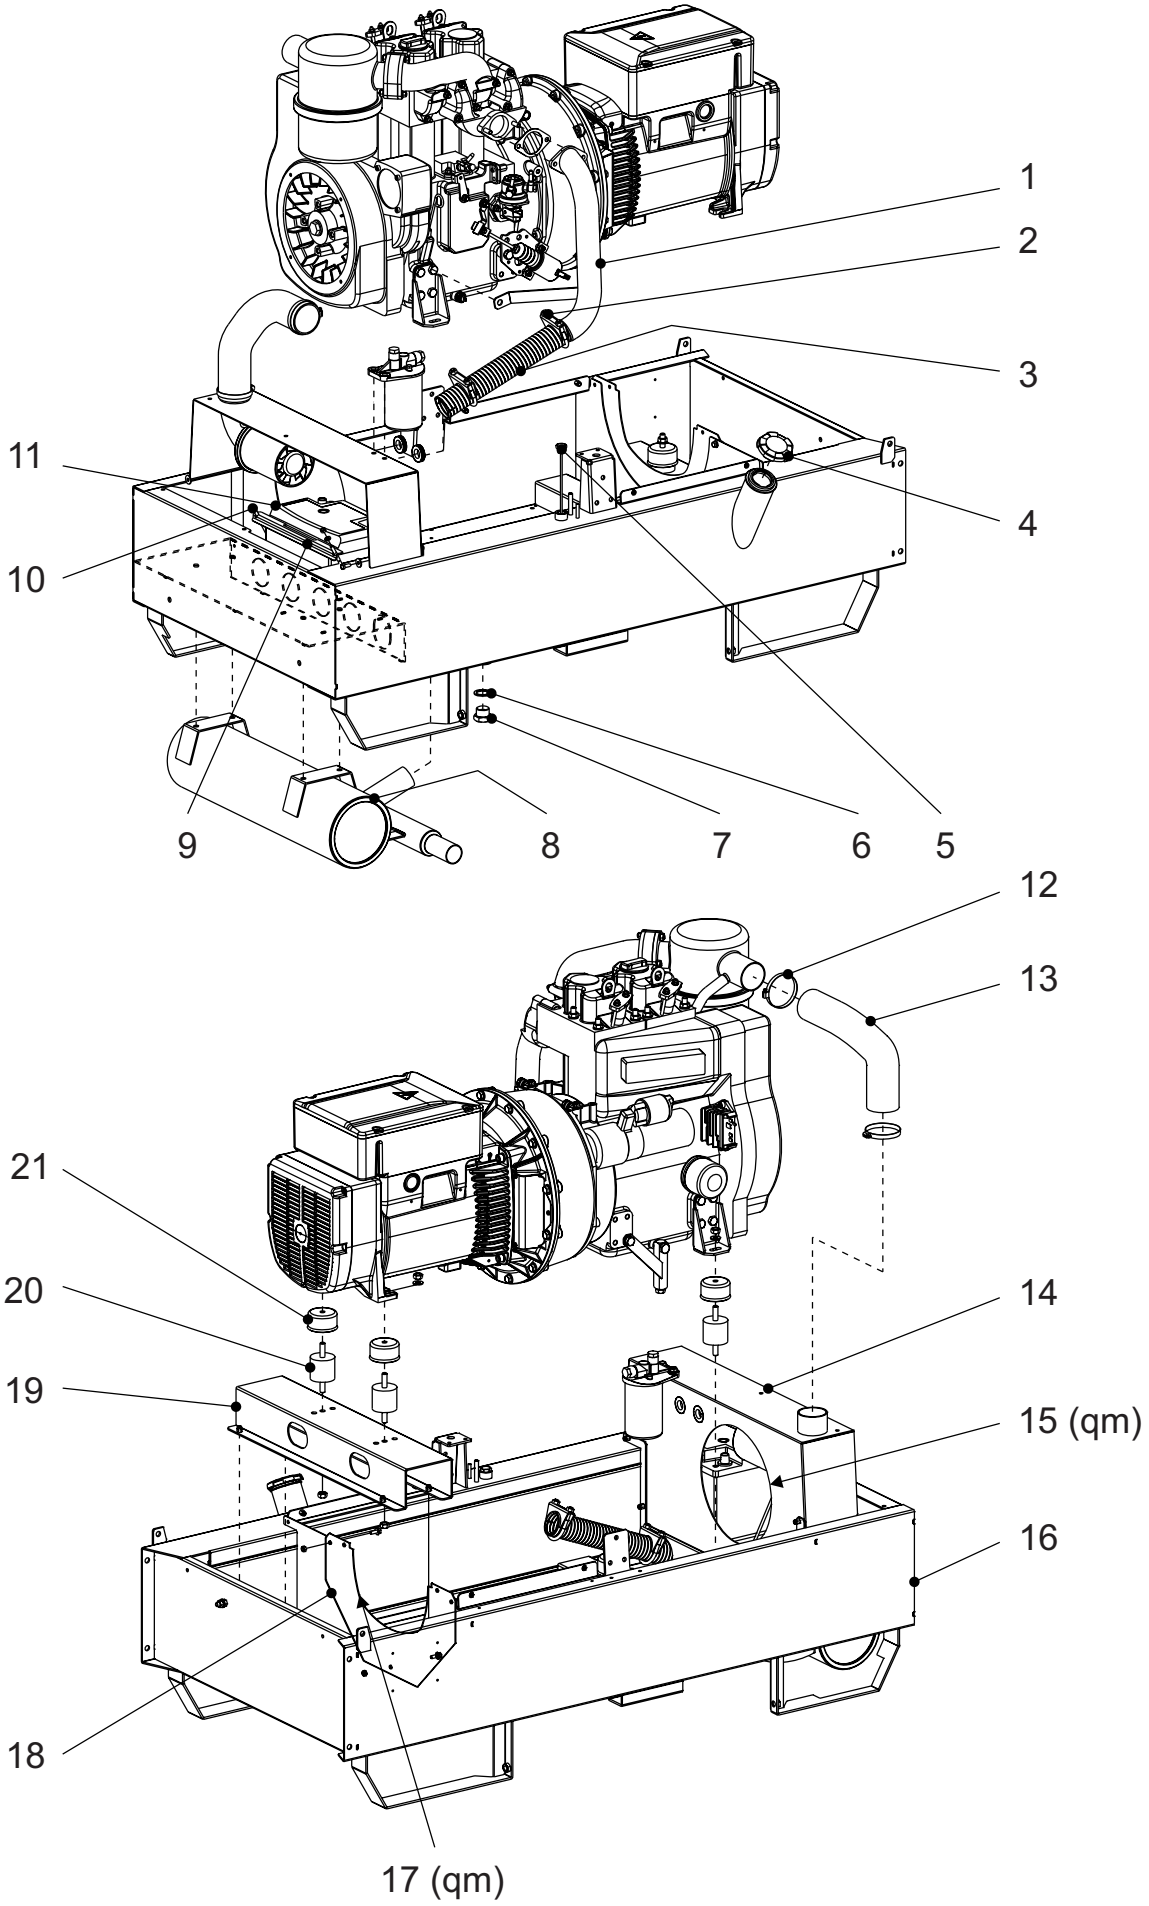
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15 (qm)
16
17 (qm)
18
19
20
21

Pos.	Cod.	Descr.	Note
1	M207602070	TUBO DI SCARICO	
2	M107302220	FASCETTA	
3	M309502077	TUBO FLESSIBILE FINITO	
4	M342202026	TAPPO SERBATOIO	
5	M305719875	GALLEGGIANTE	
6	M308102023	GUARNIZIONE	
7	M308101262	TAPPO SCARICO SERBATOIO	
8	M207402050	SILENZIATORE	
9	M102041420	TRAVERSA	
10	M105611270	TIRANTE PER BATTERIA	
11	M773749150	BATTERIA	
12	M6087700	FASCETTA	
13	M1229830	TUBO FLESSIBILE (MT.1)	
14	M215108200	PARATIA ASPIRAZIONE MOTORE	
15	M105112270	GUARNIZIONE (L=MT.1)	(qm)
16	M340100501	BASAMENTO COMPLETO (RICAMBI)	
17	M102302280	GUARNIZIONE (L=MT.1)	(qm)
18	M250208281	RIDUTTORE PARATIA INF. ALTERN.	
19	M250201072	TRAVERSA SUPP. ALTERNATORE	
20	M105112020	ANTIVIBRANTE	
21	M307012037	PROTEZIONE ANTIVIBRANTE	

Pos.	Cod.	Descr.	Note
1	M207602070	EXHAUST PIPE	
2	M107302220	CLAMP	
3	M309502077	FLEXIBLE PIPE	
4	M342202026	CAP, FUEL TANK	
5	M305719875	FLOAT	
6	M308102023	GASKET	
7	M308101262	FUEL TANK CAP	
8	M207402050	MUFFLER, EXHAUST	
9	M102041420	BRACKET	
10	M105611270	TIE ROD, BATTERY	
11	M773749150	BATTERY	
12	M6087700	CLAMP	
13	M1229830	FLEXIBLE TUBE (MT.1)	
14	M215108200	AIR INTAKE COVER	
15	M105112270	STRIP, SEALING (L=MT.1)	(qm)
16	M340100501	COMPLETE BASE (SPARE PARTS)	
17	M102302280	GASKET (L=MT.1)	(qm)
18	M250208281	UNDER COVER REDUCTION	
19	M250201072	ALTERNATOR SUPPORT	
20	M105112020	VIBRATION DAMPER	
21	M307012037	PROTECTION, VIBRATION-DAMPER	

(I) Tavola ricambi (GB) Spare parts table (F) Table piéces de rechange	(D) Ersatzteile (E) Tabla de recambios (NL)	GE 10 LSX	HK 18 REV.0-10/10

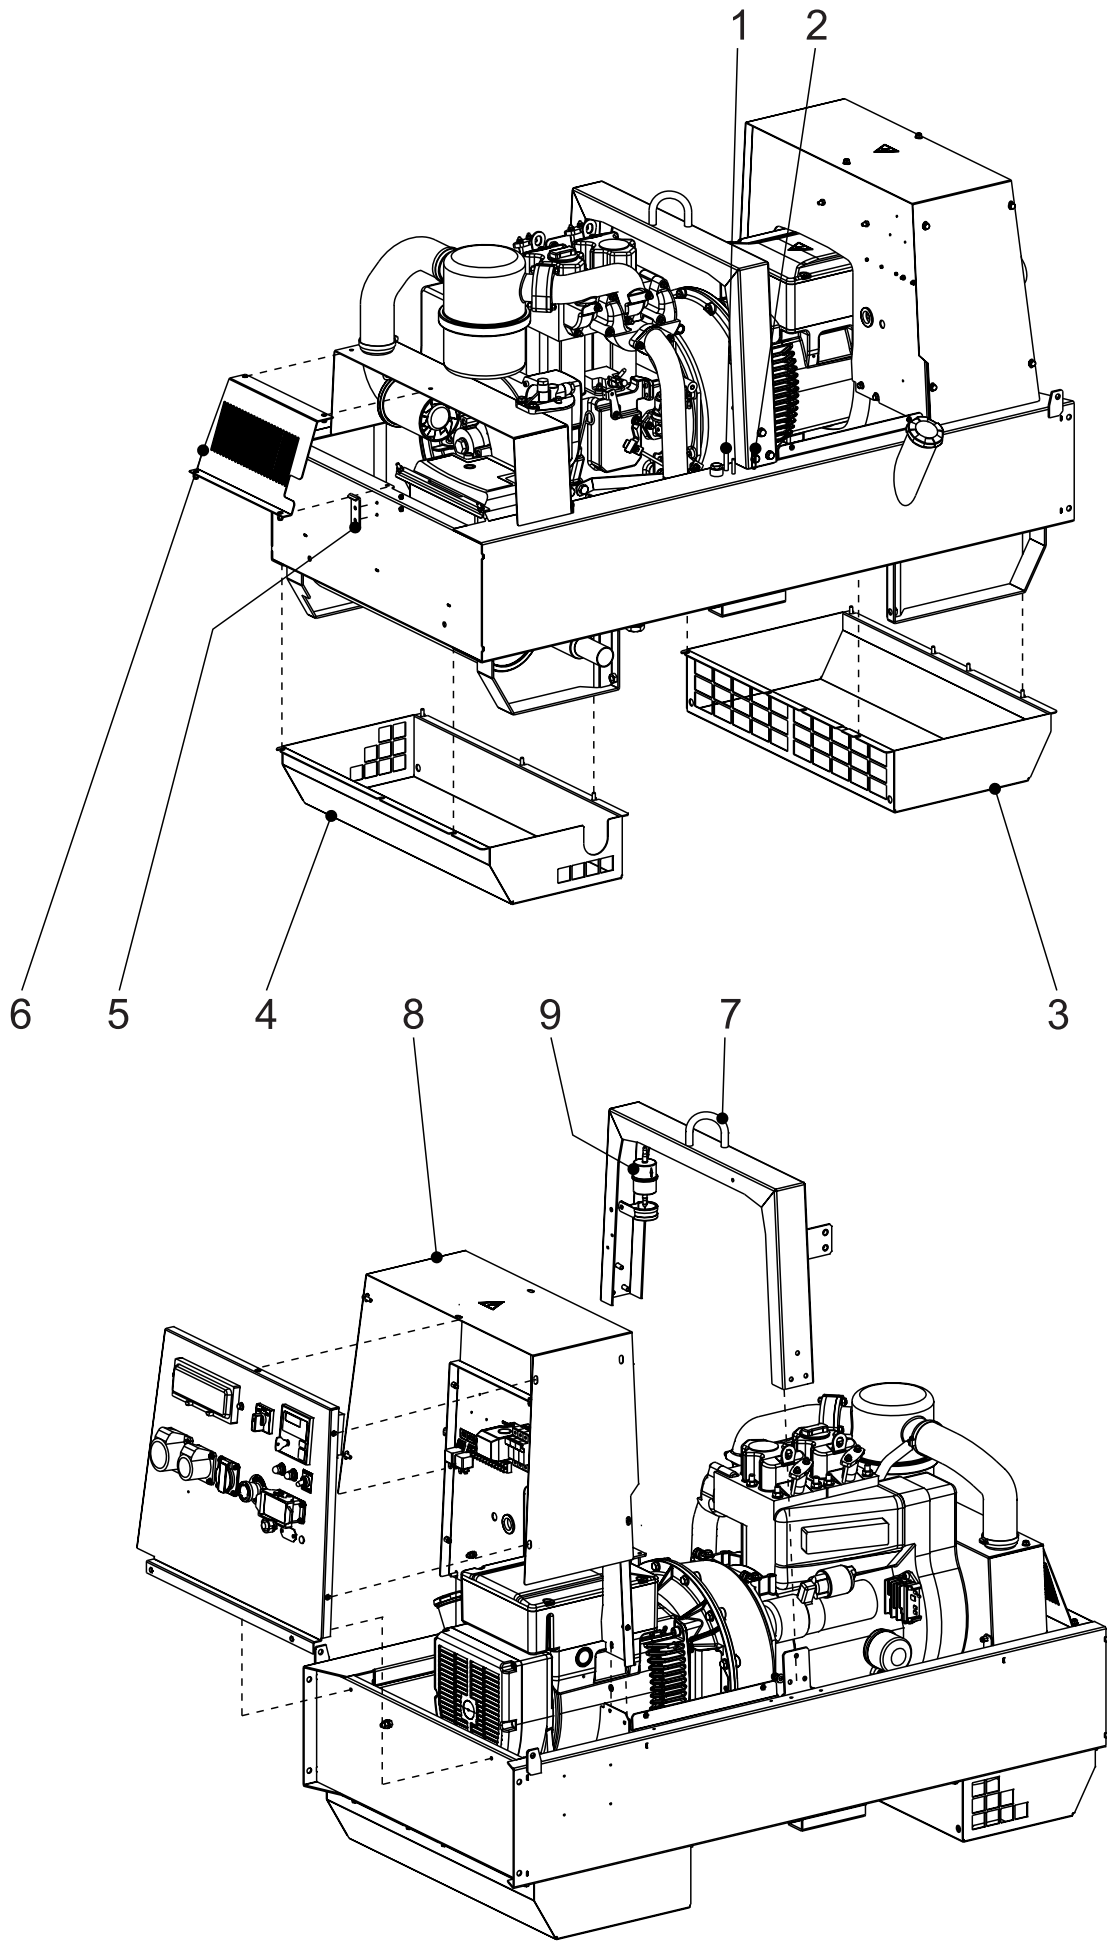

12/10/10 34010-I

Pos.	Cod.	Descr.	Note
1	M308102207	TUBO GOMMA (L=MT.1)	
2	M107301890	TUBO SFIATO (L=MT.1)	
3	M307418200	CASSONETTO ASPIRAZ.	
4	M307410515	CASSONETTO SILENZIATORE (SXC)	
5	M107300180	CHIUSURA COMPL.A LEVA	
6	M207608230	GRIGLIA	
7	M207401100	ROLL BAR	
8	M207408121	COPERTURA	
9	M256602228	FILTRO GASOLIO	

Pos.	Cod.	Descr.	Note
1	M308102207	PIPE	
2	M107301890	PIPE, BREATHER (L=MT.1)	
3	M307418200	BOX, AIR INLET	
4	M307410515	EXHAUST BOX (SXC)	
5	M107300180	LATCH	
6	M207608230	GRATING	
7	M207401100	ROLL BAR	
8	M207408121	COVER	
9	M256602228	FUEL PRE-FILTER	

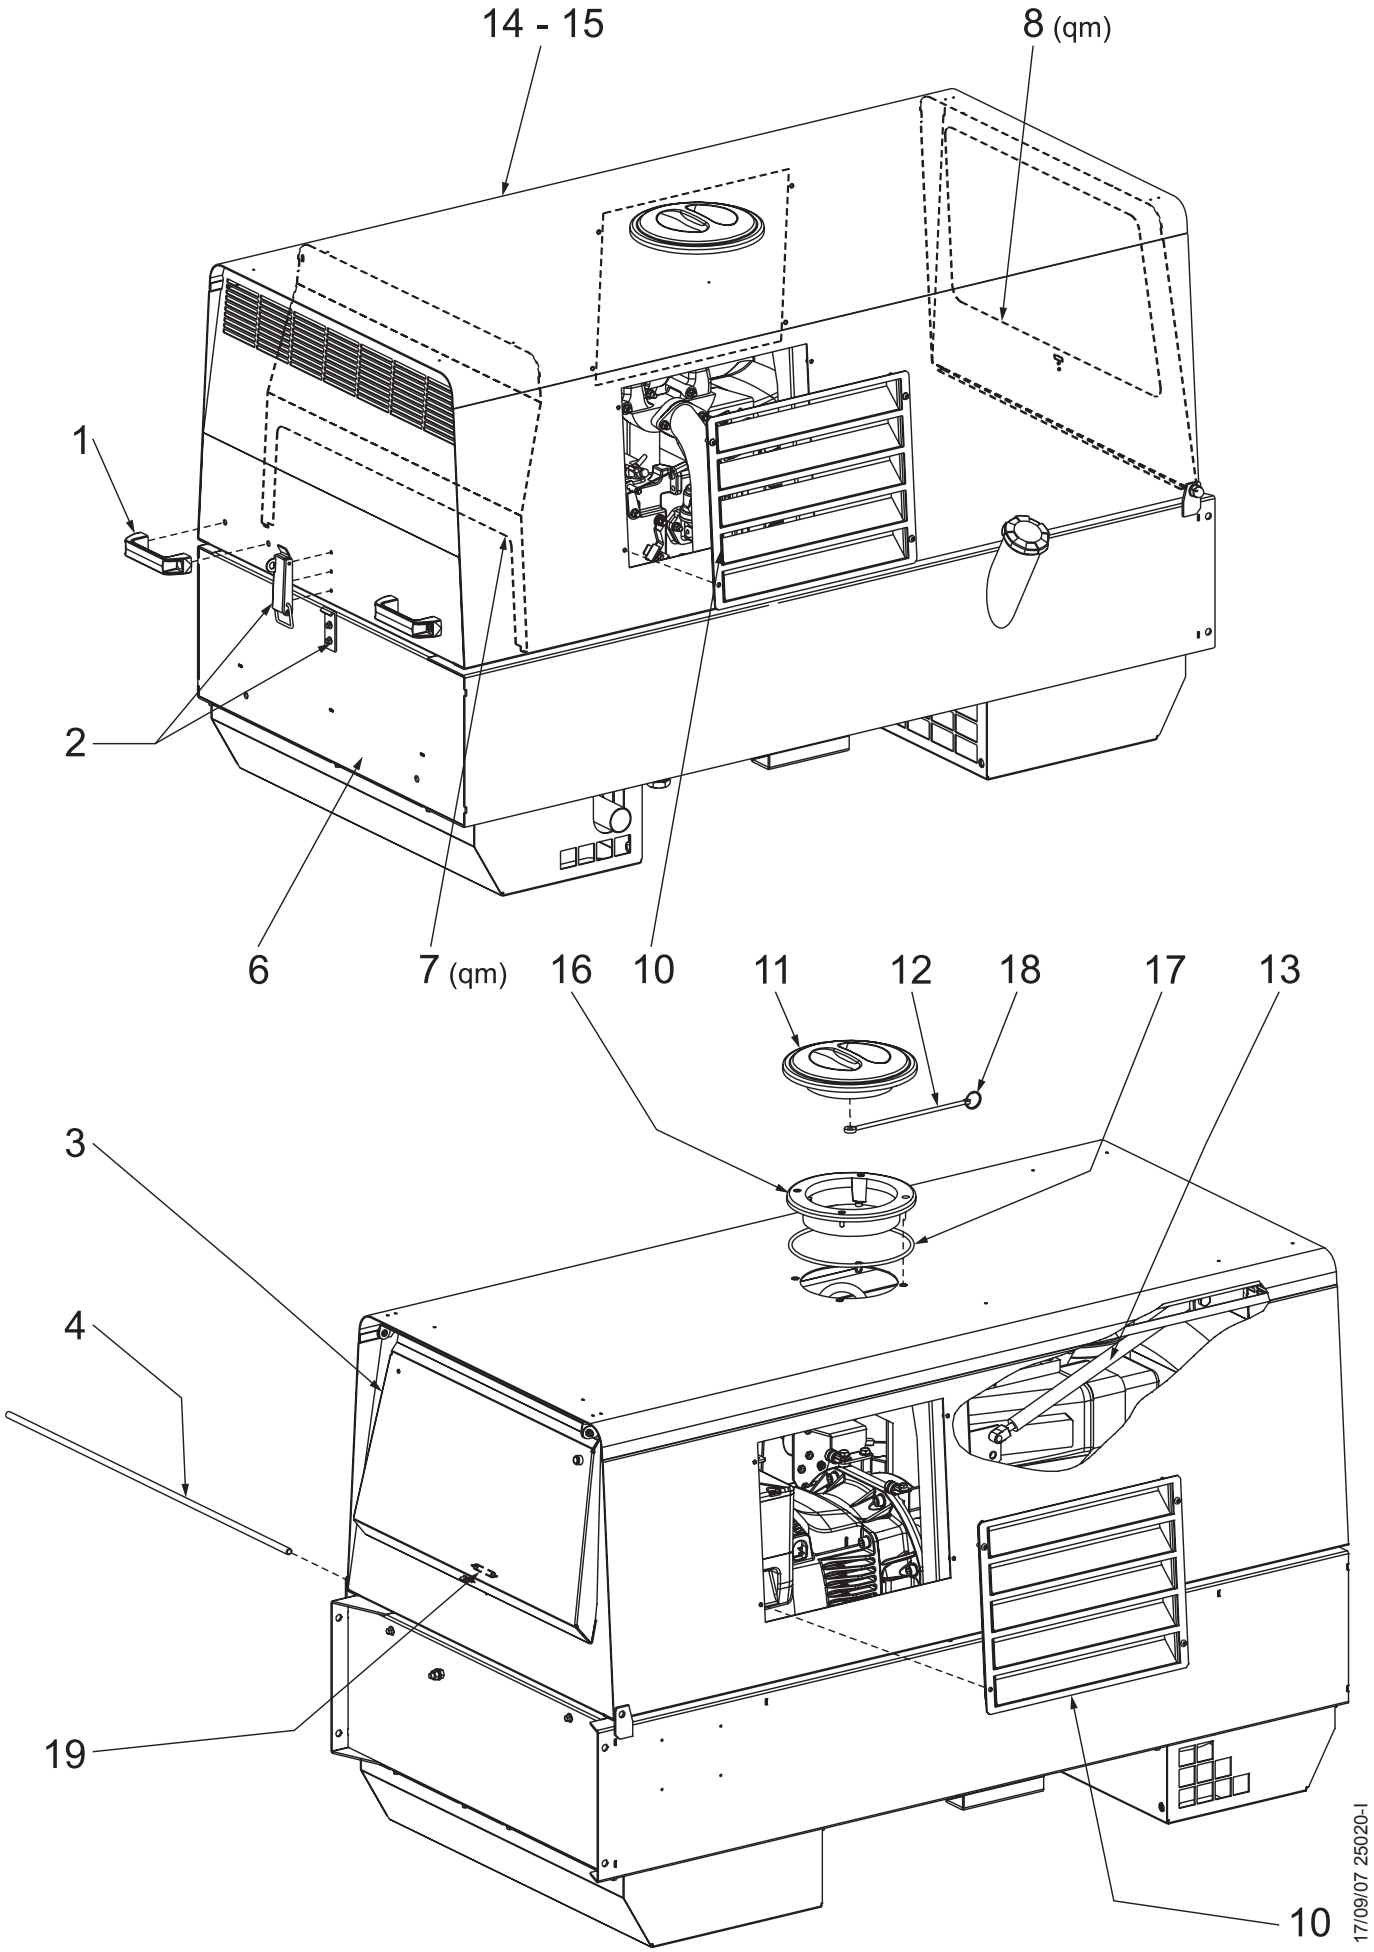
14 - 15
8 (qm)
1
2
6
7 (qm)
16
10
11
12
18
17
13
3
4
19
10
17/09/07 25020-I

Pos.	Cod.	Descr.	Note
1	M343339601	MANIGLIA / *KNOB*	
2	M107300180	CHIUSURA COMPL.A LEVA / *LATCH*	
~~3~~	~~M207408100~~	~~COPERCHIO FRONTALE / *FRONT COVER*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
3	M317608100	COPERCHIO FRONTALE / *FRONT COVER*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
4	M207408024	TIRANTE / *TIE-ROD*	
~~5~~	~~M207608270~~	~~PERNO PER CERNIERA / *HINGE PIN*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
6	M207600501	BASAMENTO COMPLETO / *BASE (COMPLETE)*	x ricambi
7	M102302280	GUARNIZIONE (L=MT.1) / *GASKET (L=MT.1)*	qm
8	M105112270	GUARNIZIONE (L=MT.1) / *STRIP, SEALING (L=MT.1)*	qm
~~9~~	~~M102042870~~	~~MOLLA / *SPRING*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
~~10~~	~~M207408065~~	~~GRIGLIA / *GRATE, AIR OUTLET*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
10	M317608065	GRIGLIA / *GRATE, AIR OUTLET*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
~~11~~	~~M209718070~~	~~COPERCHIETTO / *COVER*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
11	M841658360	COPERCHIO ERMETICO / *ERMETIC COVER*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
~~12~~	~~M209718073~~	~~TIRANTE / *TIE-ROD*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
12	M841659357	TIRANTE IN GOMMA / / *TIE-ROD*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
13	M209508115	PISTONE SOSTEGNO / *SUPPORT, AIR INLET WALL*	
~~14~~	~~M215108005~~	~~CARENATURA COMPL. / *COVER COMPL.*~~	Fino/*Up to a* REV.1-06/08 Del.66/12-25/06/12
14	M340108005	CARENATURA COMPL. / *COVER COMPL.*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
15	M250200511	GR.CARENATURA COMPL.RICAMBI / *COVER UNIT*	x ricambi
16	M841658361	GHIERA x COPER. ERMETICO / *FLANGE FOR AIR-TIGHT SEALED COVER*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
17	M1018130	ANELLO OR / *OR RING*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
18	M841659358	ANELLO DOPPIO / *DOUBLE RING*	Da/*From* REV.2-09/12 Del.66/12-25/06/12
19	M102042870	MOLLA FERMO COPERCHIO / *SPRING*	Da/*From* REV.2-09/12 Del.66/12-25/06/12

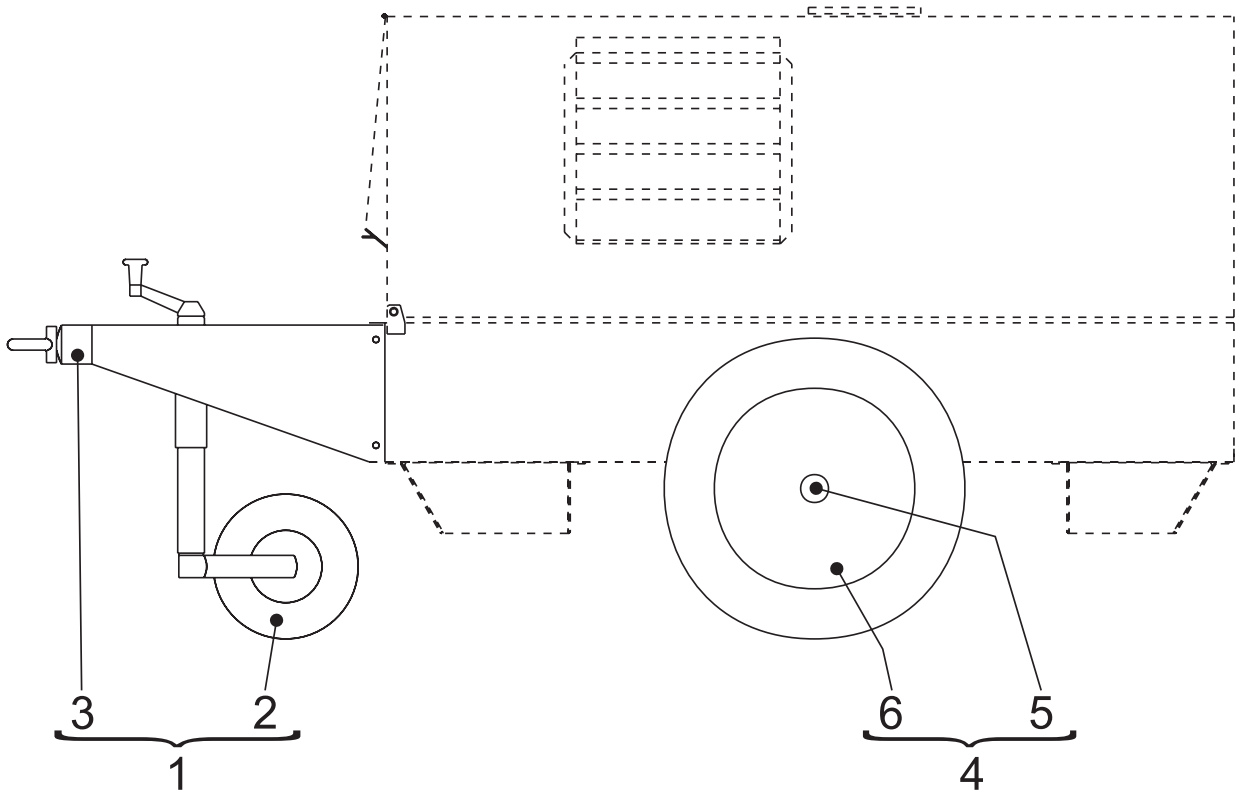

Pos.	Cod.	Descr.	Descr.	Note
1	M0000217600141	GR.TIMONE, PIEDE X TRAINO LENTO	KIT SITE TOW	
2	M102351750	PIEDE DI STAZIONAMENTO	PARKING STAND	
3	M207401150	TIMONE	TOW BAR	
4	M0000217600142	GR. ASSALE, RUOTE TRAINO LENTO	KIT SITE TOW	
5	M207401160	ASSALE	AXLE	
6	M102351740	RUOTA	WHEEL	

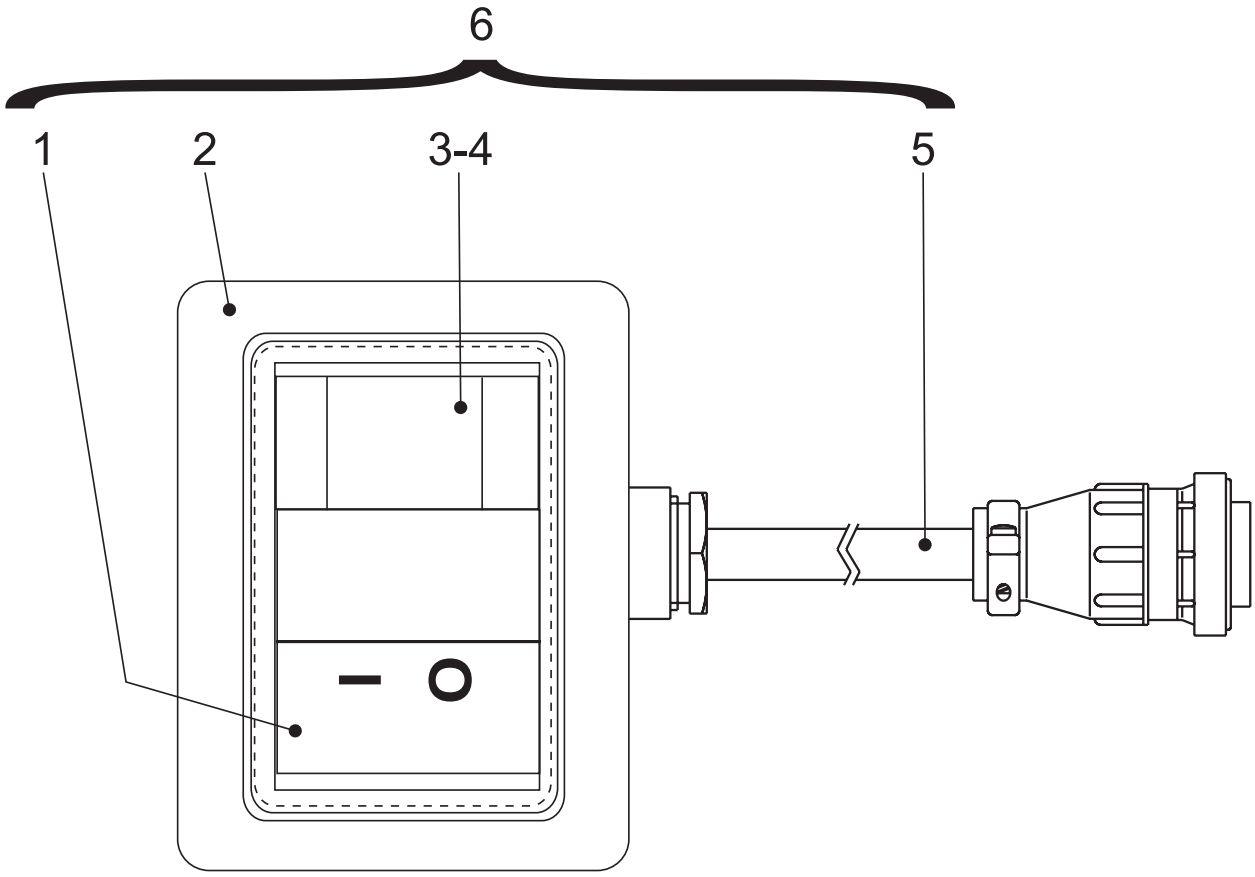

Pos.	Cod.	Descr.	Descr.
1	M930357219	INTERRUTTORE 2P 16A	*INTERRUPTER 2P 16A*
2	M930359913	SCATOLA COMPLETA	*CASE, COMPL.*
3	M930357227	LAMPADA 24V	WARNING LIGHT 24V
4	M930357231	PORTALAMPADA SPIA ROSSA	*WARNING LIGHT HOLDER*
5	M93035C060	GR. CAVI TCM	TCM CABLE KIT
6	M930350000	TCM35 COMPLETO	COMPLETE TCM35